



FLOOR PLAN
SCALE: 1:100
508.0 GSM

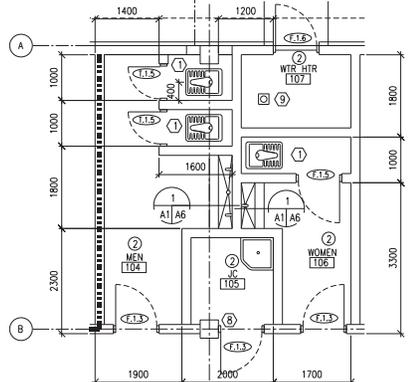

ENLARGED TOILET PLAN
SCALE: 1:50

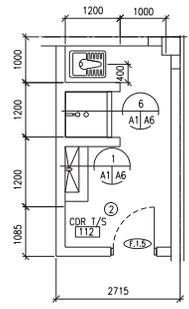

**ENLARGED TOILET/
SHOWER PLAN**
SCALE: 1:50


- KEY NOTES:**
- TYPICAL TOILET STALL LAYOUT - RE: DETAIL 2/A6
 - TYPICAL TOILET LAYOUT - RE: DETAIL 3/A6
 - LINE OF CANDY ABOVE
 - NOT USED.
 - TWO-PIECE WALL THIMBLE AND TRIM PLATE FOR OPTIONAL WOOD BURNING STOVE CHIMNEY PIPE. STOVE AND PIPE BY OTHERS.
 - CONCRETE STOOP - RE: DETAIL 3/A4
 - LINE OF ROOF OVERHANG ABOVE
 - MOUNT DOOR FRAME FLUSH TO COLUMN.
 - FLOOR DRAIN - RE: P1

- LEGEND:**
- DOOR TYPE, SEE SHEET A5
 - WINDOW TYPE, SEE SHEET A5
 - KEY NOTE
 - FIRE EXTINGUISHER CABINET
 - 1-HOUR RATED PARTITION
 - 2-HOUR RATED PARTITION
 - ROOM FINISH TYPE DESIGNATION
 - METAL DOWNSPOUT

- GENERAL NOTES:**
- INTERIOR PARTITIONS SHALL BE 200 MM CMU UNLESS NOTED OTHERWISE.
 - OPENINGS FOR DOORS SHALL BE LOCATED 200 MM FROM THE ADJACENT WALL UNLESS NOTED OTHERWISE.
 - SURFACES TO BE PAINTED SHALL BE CLEAN AND FREE OF FOREIGN MATTER BEFORE APPLICATION OF PAINT. CLEANING SHALL BE SCHEDULED SO THAT DUST AND OTHER CONTAMINANTS WILL NOT FALL ON WET, NEWLY PAINTED SURFACES.
 - CONCRETE AND INTERIOR MASONRY SURFACES GROUTED SOLID SHALL BE ALLOWED TO DRY AT LEAST 30 DAYS BEFORE PAINTING EXCEPT CONCRETE SLAB ON GRADE WHICH SHALL BE ALLOWED TO CURE 90 DAYS BEFORE PAINTING.
 - PAINTS CONTAINING LEAD IN EXCESS OF 0.06 PERCENT BY WEIGHT OF THE TOTAL NONVOLATILE CONTENT SHALL NOT BE USED.
 - MERCURIAL FUNGICIDES SHALL NOT BE USED IN OIL-BASE PAINT.
 - REMOVE LOOSE DIRT AND CLEAN SURFACES BEFORE PAINTING. APPLY PAINT TO INTERIOR STRUCTURAL RIGID FRAMINGS AND CEILINGS AND TEST FOR ADHESION. PRIMER COAT FOR MASONRY. INITIAL FIRST COAT WITH AN ACRYLIC LATEX PAINT FOR EXTERIOR SURFACES AND A SECOND COAT WITH A WATER REPELLENT ACRYLIC LATEX PAINT.
 - METAL DOORS AND FRAMES SHALL RECEIVE A PRIMER COAT PLUS TWO COATS OF PAINT.
 - DIMENSIONS ARE TO STRUCTURAL COLUMN GRID, EDGE OF WINDOW OPENINGS, AND TO HINGE SIDE OF DOOR OPENINGS.
 - FILL ANULAR SPACE AT ANY AND ALL PENETRATIONS IN FIRE RATED FLOORS, PARTITIONS AND CEILINGS WITH APPROPRIATE FIRE STOPPING MATERIALS.
 - CORRIDOR WALLS ARE NOT RATED IN ACCORDANCE WITH NFPA 101, 38.3.6.1(2).
 - PROVIDE OCCUPANCY SEPARATION IN ACCORDANCE WITH NFPA 101, 38.1.2, 38.3.2, AND TABLE 6.1.14.4.1.

- ROOM FINISHES:**
- WALLS: PAINTED PLASTER
FLOOR: SEALED CONCRETE
CEILING: PAINTED PLASTER APPLIED TO STRUCTURE
 - WALLS: 2400 MM HIGH CERAMIC TILE
WAINSCOT, PAINTED PLASTER ABOVE WAINSCOT
FLOOR: CERAMIC TILE
CEILING: PAINTED PLASTER

AD9



US Army Corps of Engineers
Afghanistan Engineer District

NO.	DATE	DESCRIPTION

DESIGNED BY: DATE: 09-30-09
KOB
DWG BY: KJC
CHK BY: NLJ
SUBMITTED BY: BAKER
FILE NO.:
DRAWING:

Michael Baker Jr. Inc.
A Unit of HOK Group
1000 Independence Blvd.
Moon Township, PA 15108
www.mbakercorp.com

AFGHAN NATIONAL POLICE
STANDARD DESIGN
ADMINISTRATION BUILDING (508 GSM)
ELECTRICAL OPTION
FLOOR PLAN

SHEET REFERENCE NUMBER:
A1

100% SUBMISSION