NOTES

1. FUTURE BASE LOAD TO BE ADDED TO THIS CIRCUIT IN THIS GENERAL CIRCUIT LOCATION. DETAILED DESIGN TO PROVIDE ACTUAL TAP LOCATIONS AND ROUTING TO SERVE MULTIPLE BUILDINGS AND STRUCTURES.
2. RECOMMENDATION TO MOVE EXISTING CIRCUIT LOADS TO NEW OR ALTERNATE CIRCUIT FOR LOAD BALANCING PURPOSES.
3. BLUE COLOR SHADED LOADS INDICATE NEAR TERM AND LONG TERM FUTURE LOAD ADDITIONS.
4. HATCHED AREAS INDICATE RECOMMENDED LOADS TO BE RELOCATED TO A DIFFERENT CIRCUIT.
5. LOADS SHOWN IN DASHED RECTANGLE INDICATE FUTURE LOADS WHICH MAY REQUIRE MORE THAN ONE TAP FROM OVERHEAD LINE CIRCUIT.

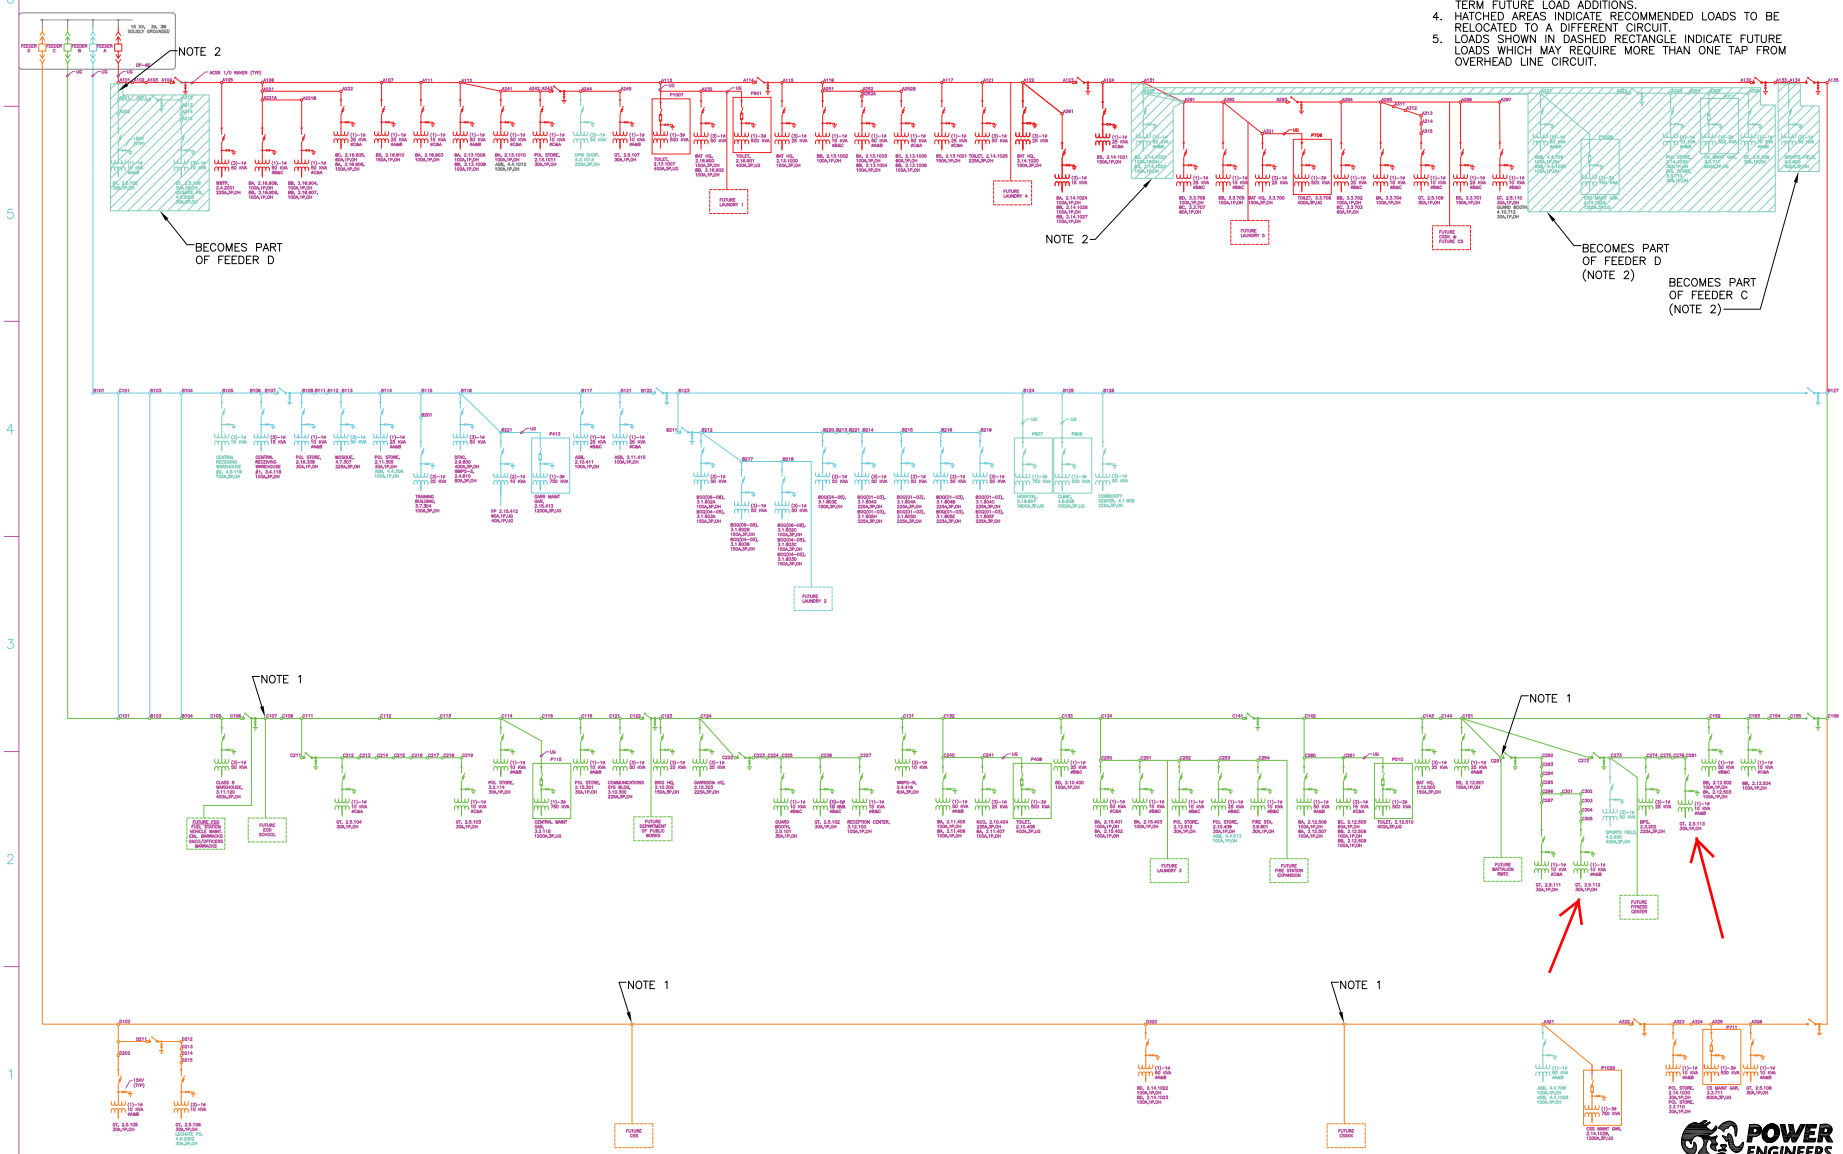

UNLESS OTHERWISE NOTED, ALL DIMENSIONS SHOWN ARE IN METERS.

90% PRE-FINAL SUBMITTAL

SYMB	DESCRIPTION	DATE	APR.
B	90% PRE-FINAL SUBMITTAL	06/06/10	SEP
A	50% CONCEPT DESIGN SUBMITTAL	05/03/10	SEP

DESIGNED BY: ARC
DATE: 05/03/10
DRAWN BY: ARC
SUBMITTED BY: TETRA TECH
CHECKED BY: SEP
FILE NO.: SHAHEEN-P3

US Army Corps of Engineers
Middle East District

TETRA TECH

MASTER PLAN AT CAMP SHAHEEN AND CAMP SPANN AFGHAN NATIONAL ARMY (ANA) GARRISON, AFGHANISTAN
MASTER PLAN ELECTRICAL SITE
15KV DISTRIBUTION
SINGLE LINE DIAGRAM

SHEET REFERENCE NUMBER:
P3

POWER ENGINEERS
www.powereng.com

\\bolfs1\projects\119572\DD\CAD\dwg\elec\SHAHEEN-P3.dwg 6/1/2010 4:34:00 PM Devin Jones 6456