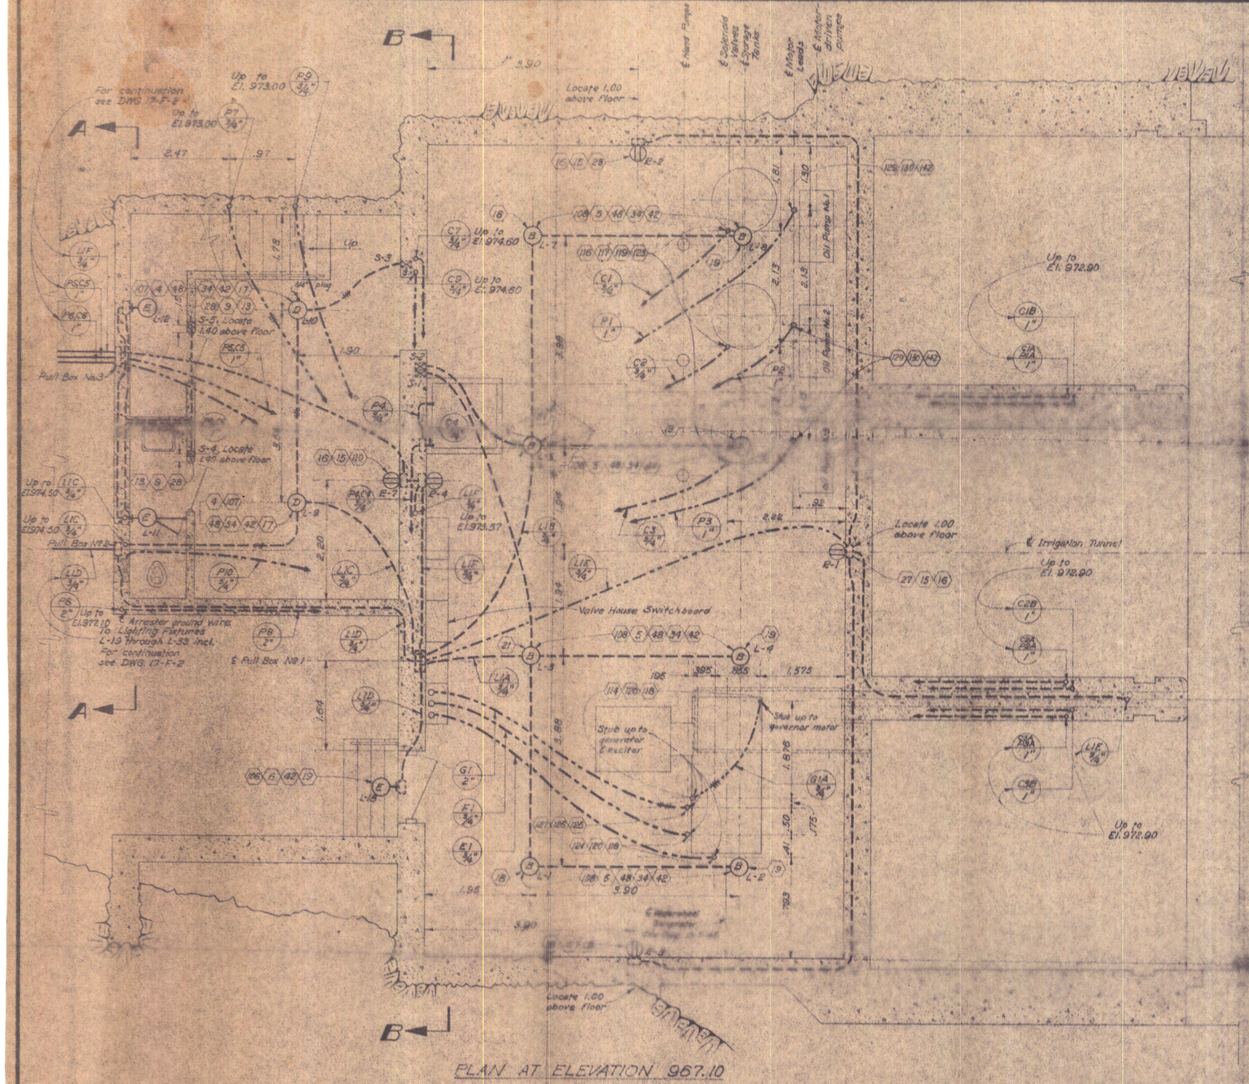

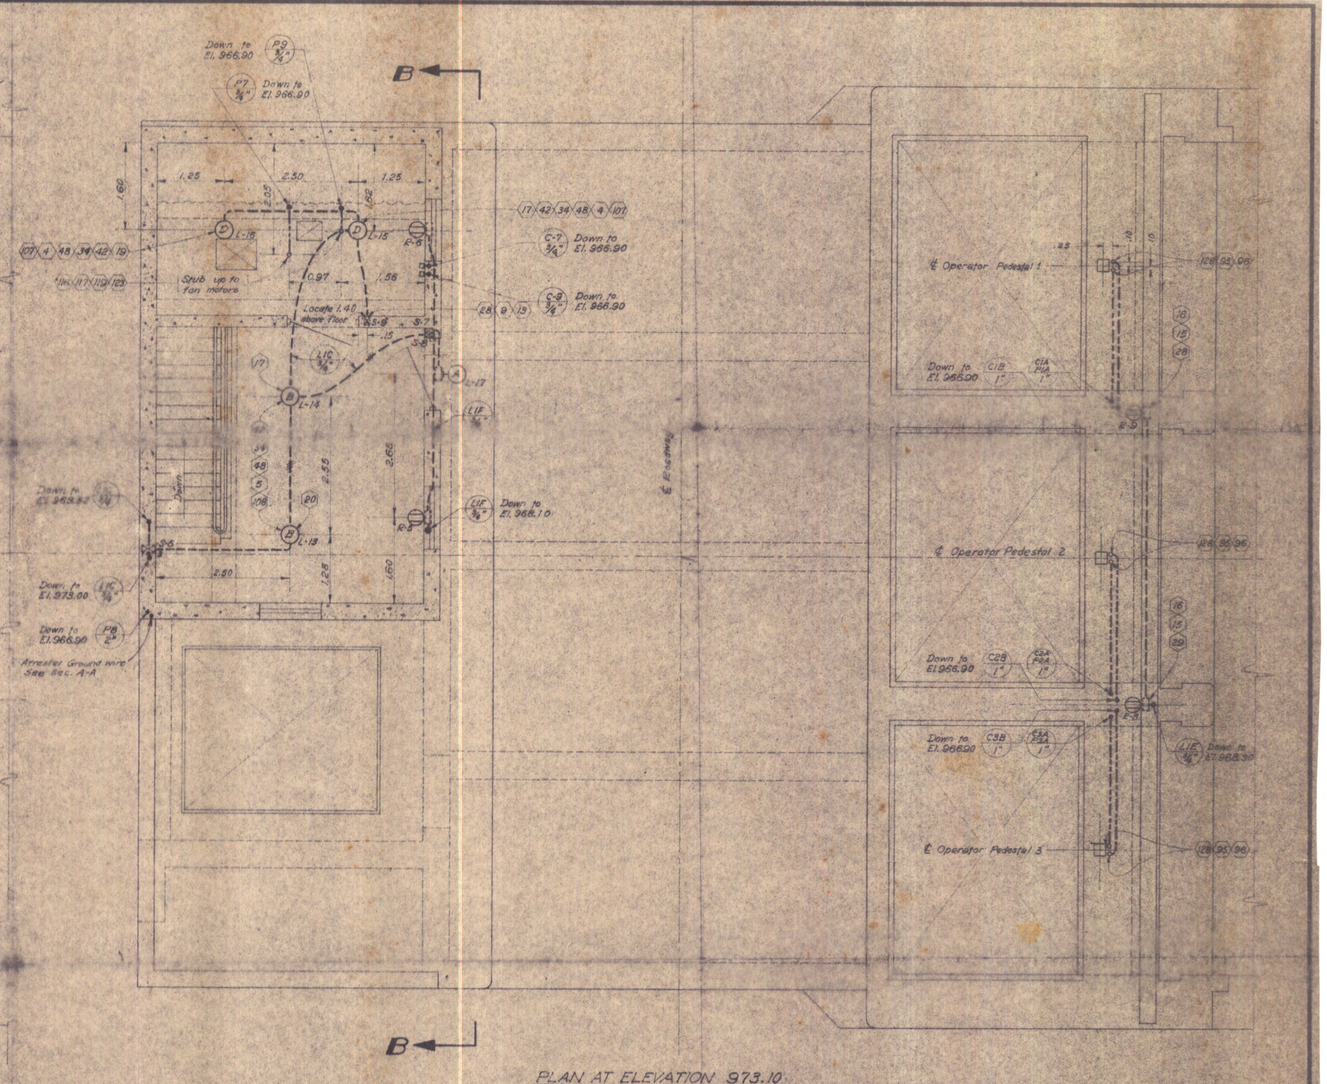

GENERAL NOTES

1. Bill of Material listing is shown on DWG 17-F-4
2. All control wires to be #12 type TW.
3. All power circuit wire sizes are given on DWG 17-F-5
4. All lighting circuits to be #12 TW wire in ¾" conduit.
5. Were bought on P.O. 11.5012.

LEGEND

- Conduit embedded in walls or ceiling
- Conduit embedded in floor
- Conduit bend upwards
- Conduit bend down

REFERENCE DRAWINGS

17-F-4	Valve House Power & Lighting – Sections
17-F-2	Valve Chamber & Tunnel Power & Lighting
17-F-5	Valve House Switchboard - Elementary Wiring
17-F-1	Irrigation Tunnel Grounding Plan
17-F-7	Emergency Generator House - Power & Lighting
	Switchboard Manufacturers Drawings on P.O. 11.5082

Scale 1:50

MORRISON - KNUDSEN AFGHANISTAN, INC.

KAJAKAI DAM

VALVE HOUSE POWER AND LIGHTING PLANS

INTERNATIONAL ENGINEERING CO., INC.

DESIGNED W.E.S.	CHKD. E.M.M.	SUBMITTED
DRAWN W.E.S.	INSP. E.L.M.	RECOMMENDED
		APPROVED

17-F-3

SAN FRANCISCO, CAL.

DATE AUGUST 27, 1952