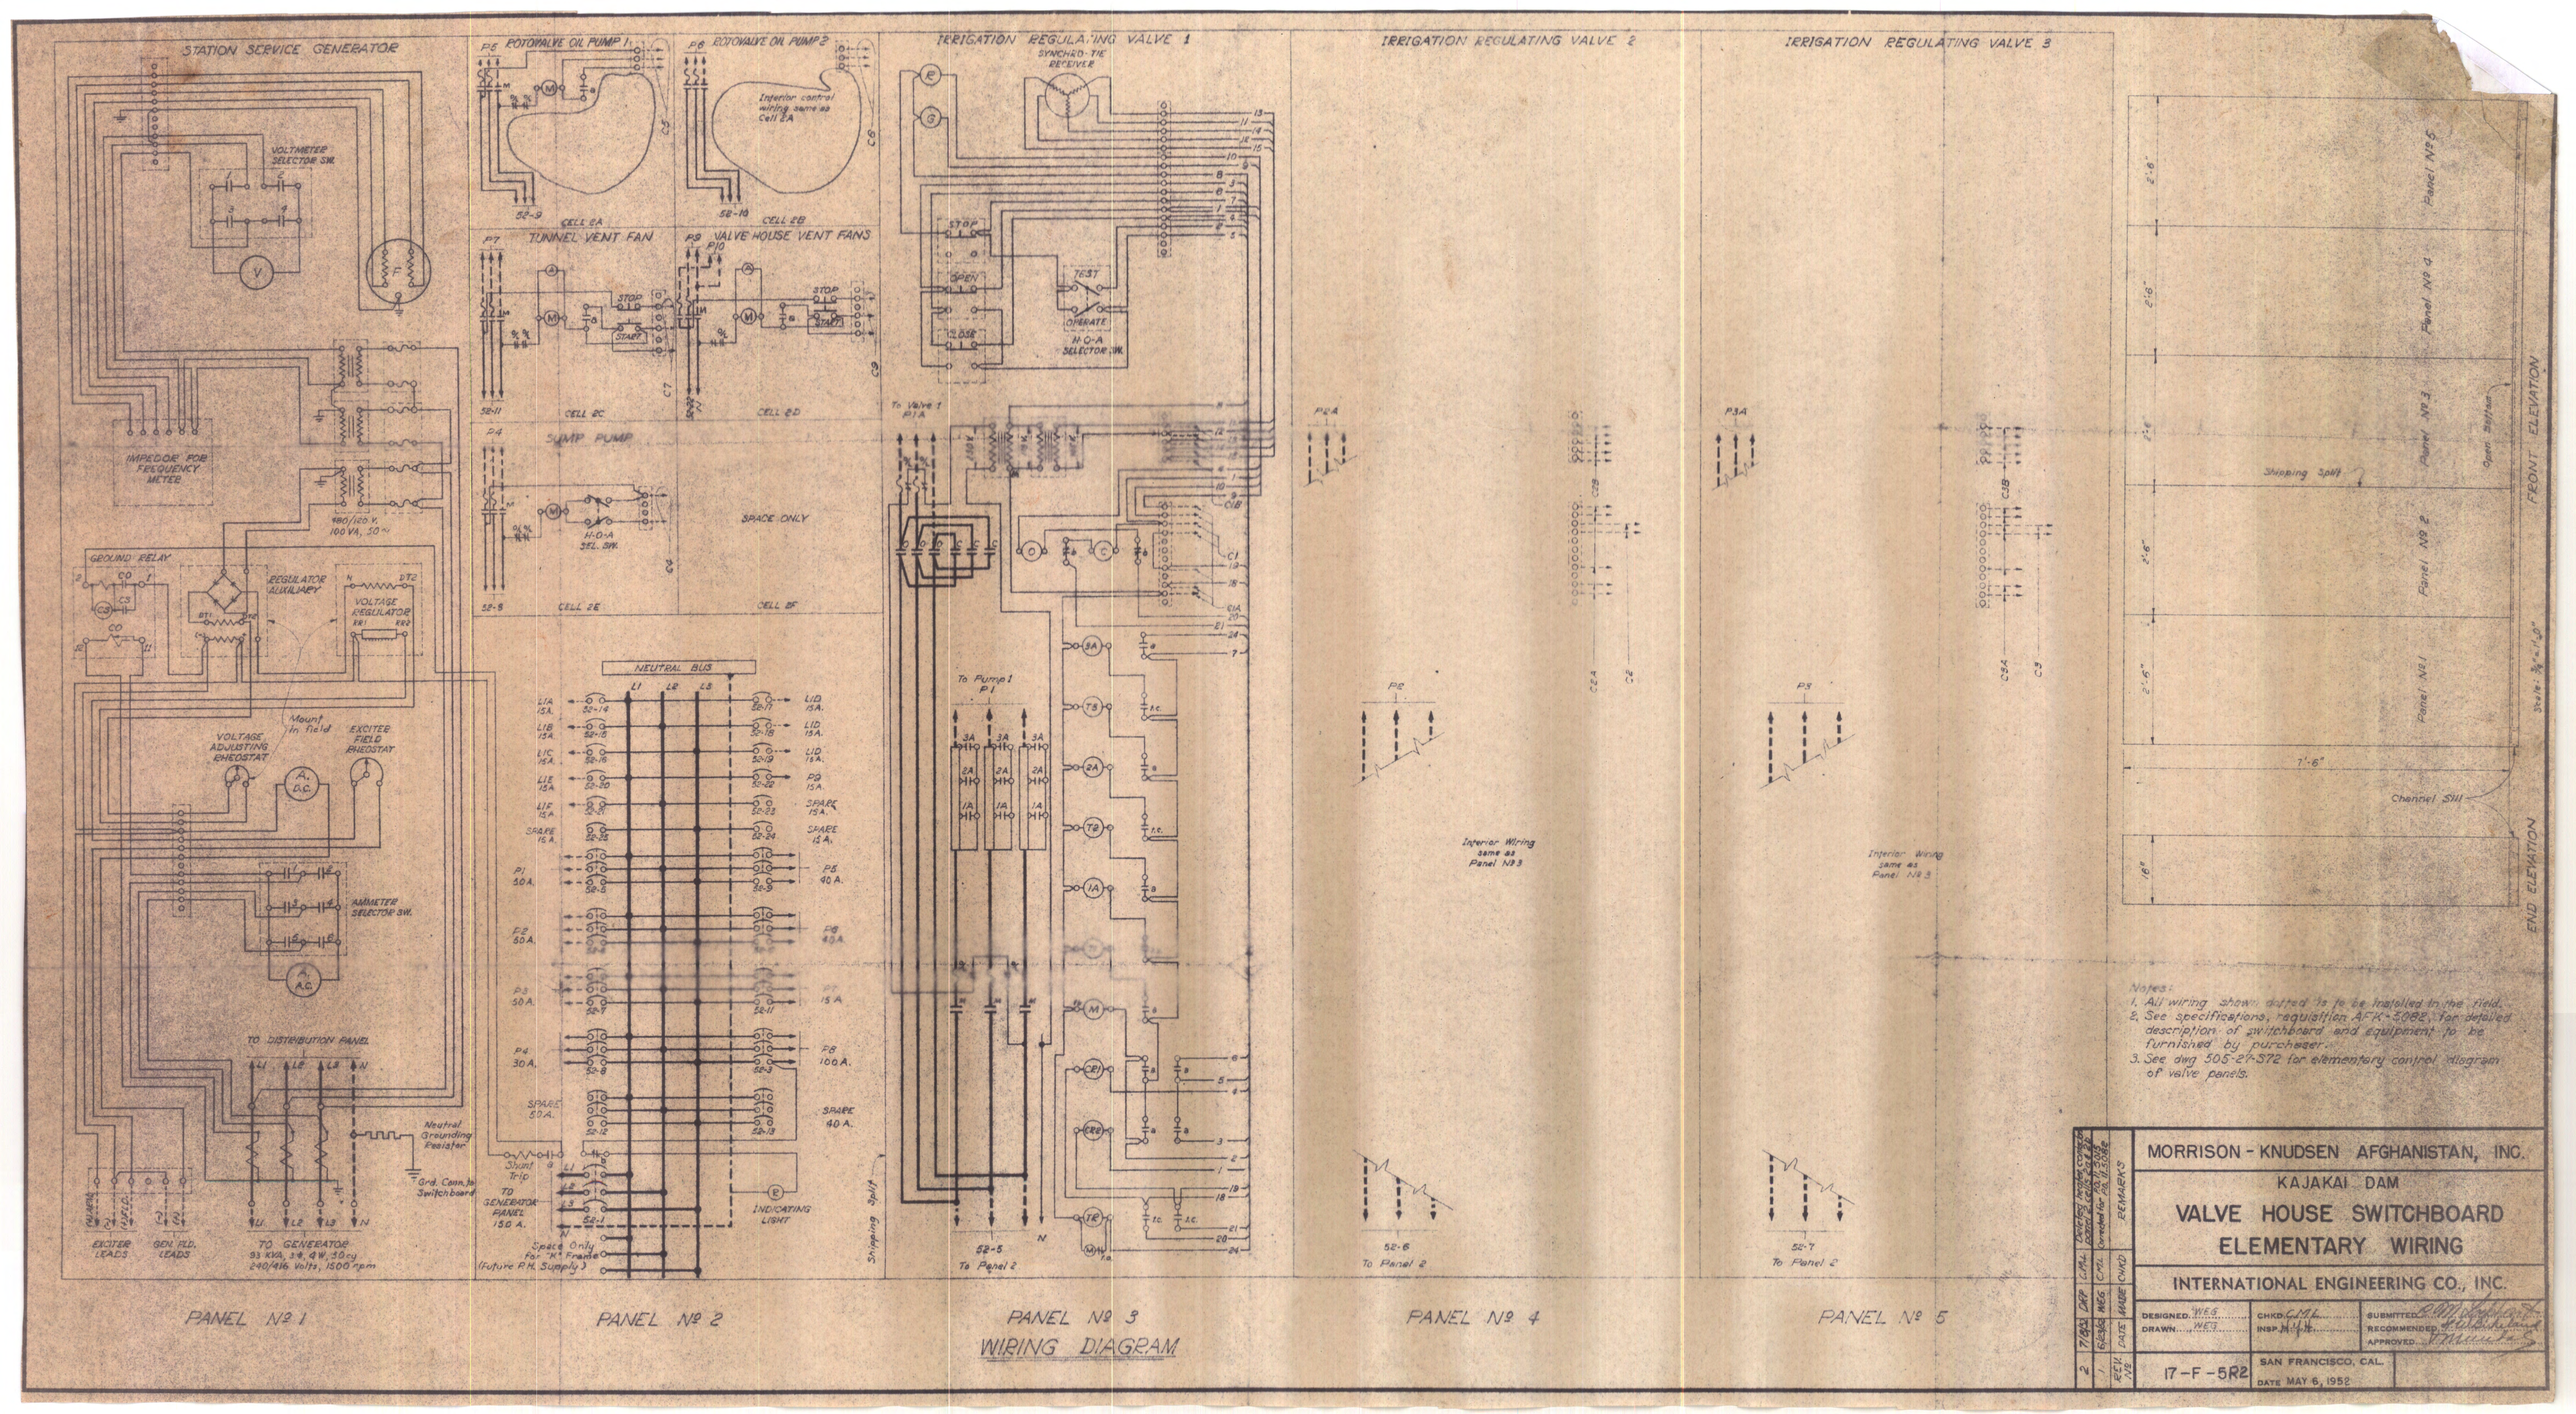

Notes:
1. All wiring shown dotted is to be installed in the field.
2. See specifications, requisition AFK-5082, for detailed description of switchboard and equipment to be furnished by purchaser.
3. See dwg 505-2-S72 for elementary control diagram of valve panels.

NO.	DATE	MADE	CHKD	REMARKS
2	7/1/53	DRP	CML	Control Power Circuits Changed for 208 V. 3 Phase
1	6/23/54	WEG	CML	Corrected for 208 V. 3 Phase

MORRISON - KNUDSEN AFGHANISTAN, INC.

KAJAKAI DAM

VALVE HOUSE SWITCHBOARD ELEMENTARY WIRING

INTERNATIONAL ENGINEERING CO., INC.

DESIGNED WEG | CHKD CML | SUBMITTED
DRAWN WEG | INSP. M.H.T. | RECOMMENDED
APPROVED

17-F-5R2

SAN FRANCISCO, CAL.

DATE MAY 6, 1952