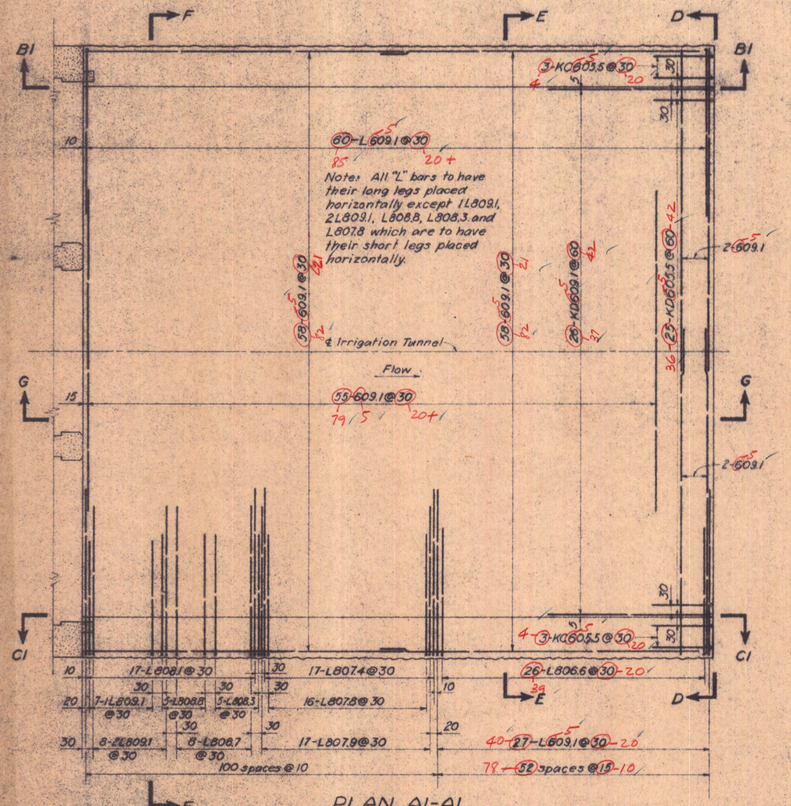

PLAN A1-A1
BOTTOM FACE REINFORCEMENT
(Wall concrete not shown)

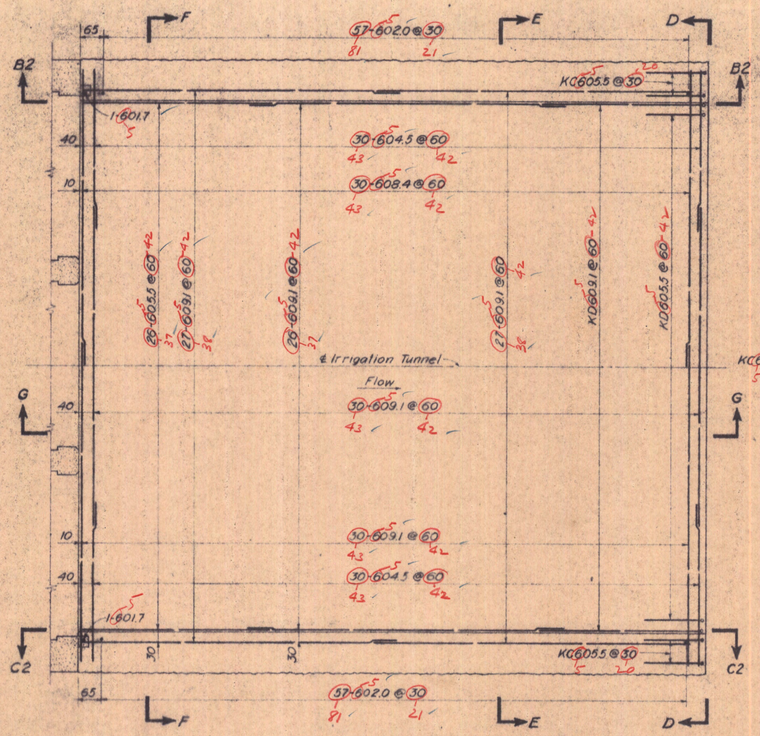

PLAN A2-A2
TOP FACE REINFORCEMENT
(Wall concrete not shown)

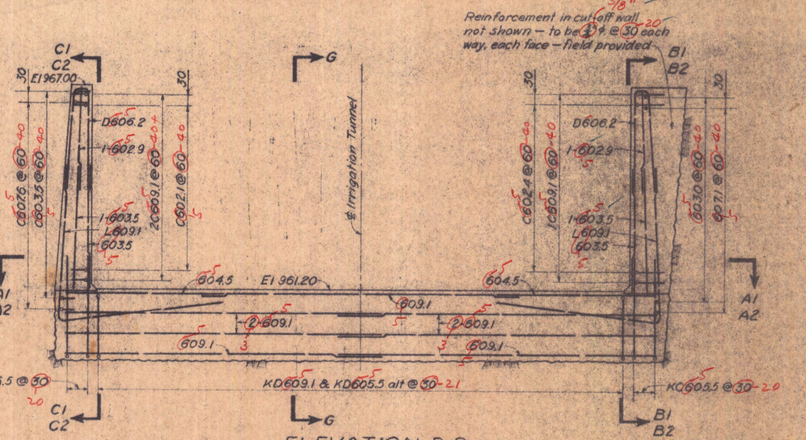

ELEVATION D-D



SECTION H-H

NOTES:
Bar spacings are in centimeters, elevations are in meters.
Minimum cover to ℄ of bars shall be 10 centimeters, except as noted.
Lap all bars 37 diameters.
Alternate laps of longitudinal bars wherever possible.
——— indicates bar bent away from viewer.
——— indicates bar bent toward viewer.

REFERENCE DRAWINGS:
Irrigation Tunnel — Valve House — Concrete Outline — Sheet 3 ..... 13-F-44
Reinforcement Bar Details ..... 13-F-67 A, B and C

COMPANION DRAWING 13-F-67

Scale: 1:75

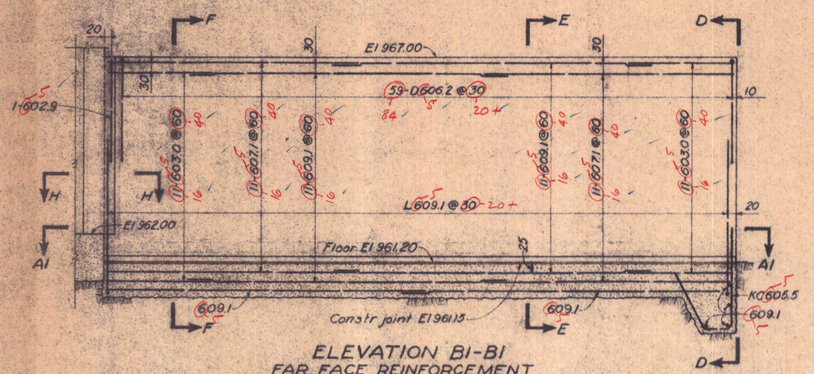

ELEVATION B1-B1
FAR FACE REINFORCEMENT
(Top face reinforcement in slab not shown)

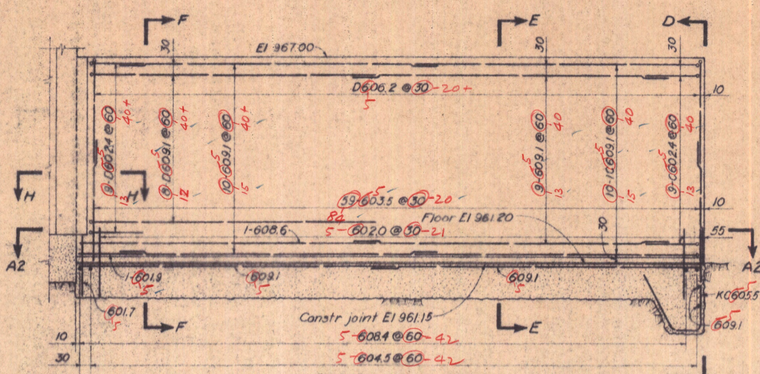

ELEVATION B2-B2
NEAR FACE REINFORCEMENT
(Bottom face reinforcement in slab not shown)



SECTION J-J

CHANNEL LINING

MORRISON - KNUDSEN AFGHANISTAN, INC.

KAJAKAI DAM

IRRIGATION TUNNEL VALVE HOUSE REINFORCEMENT - SHEET 8

INTERNATIONAL ENGINEERING CO., INC.

DESIGNED G.I.B.	CHKD [illegible]	SUBMITTED [illegible]
DRAWN G.I.B.	INSP. [illegible]	RECOMMENDED [illegible]
		APPROVED [illegible]

13-F-66 R1 (MKA)

SAN FRANCISCO, CAL.

DATE JUNE 20, 1952