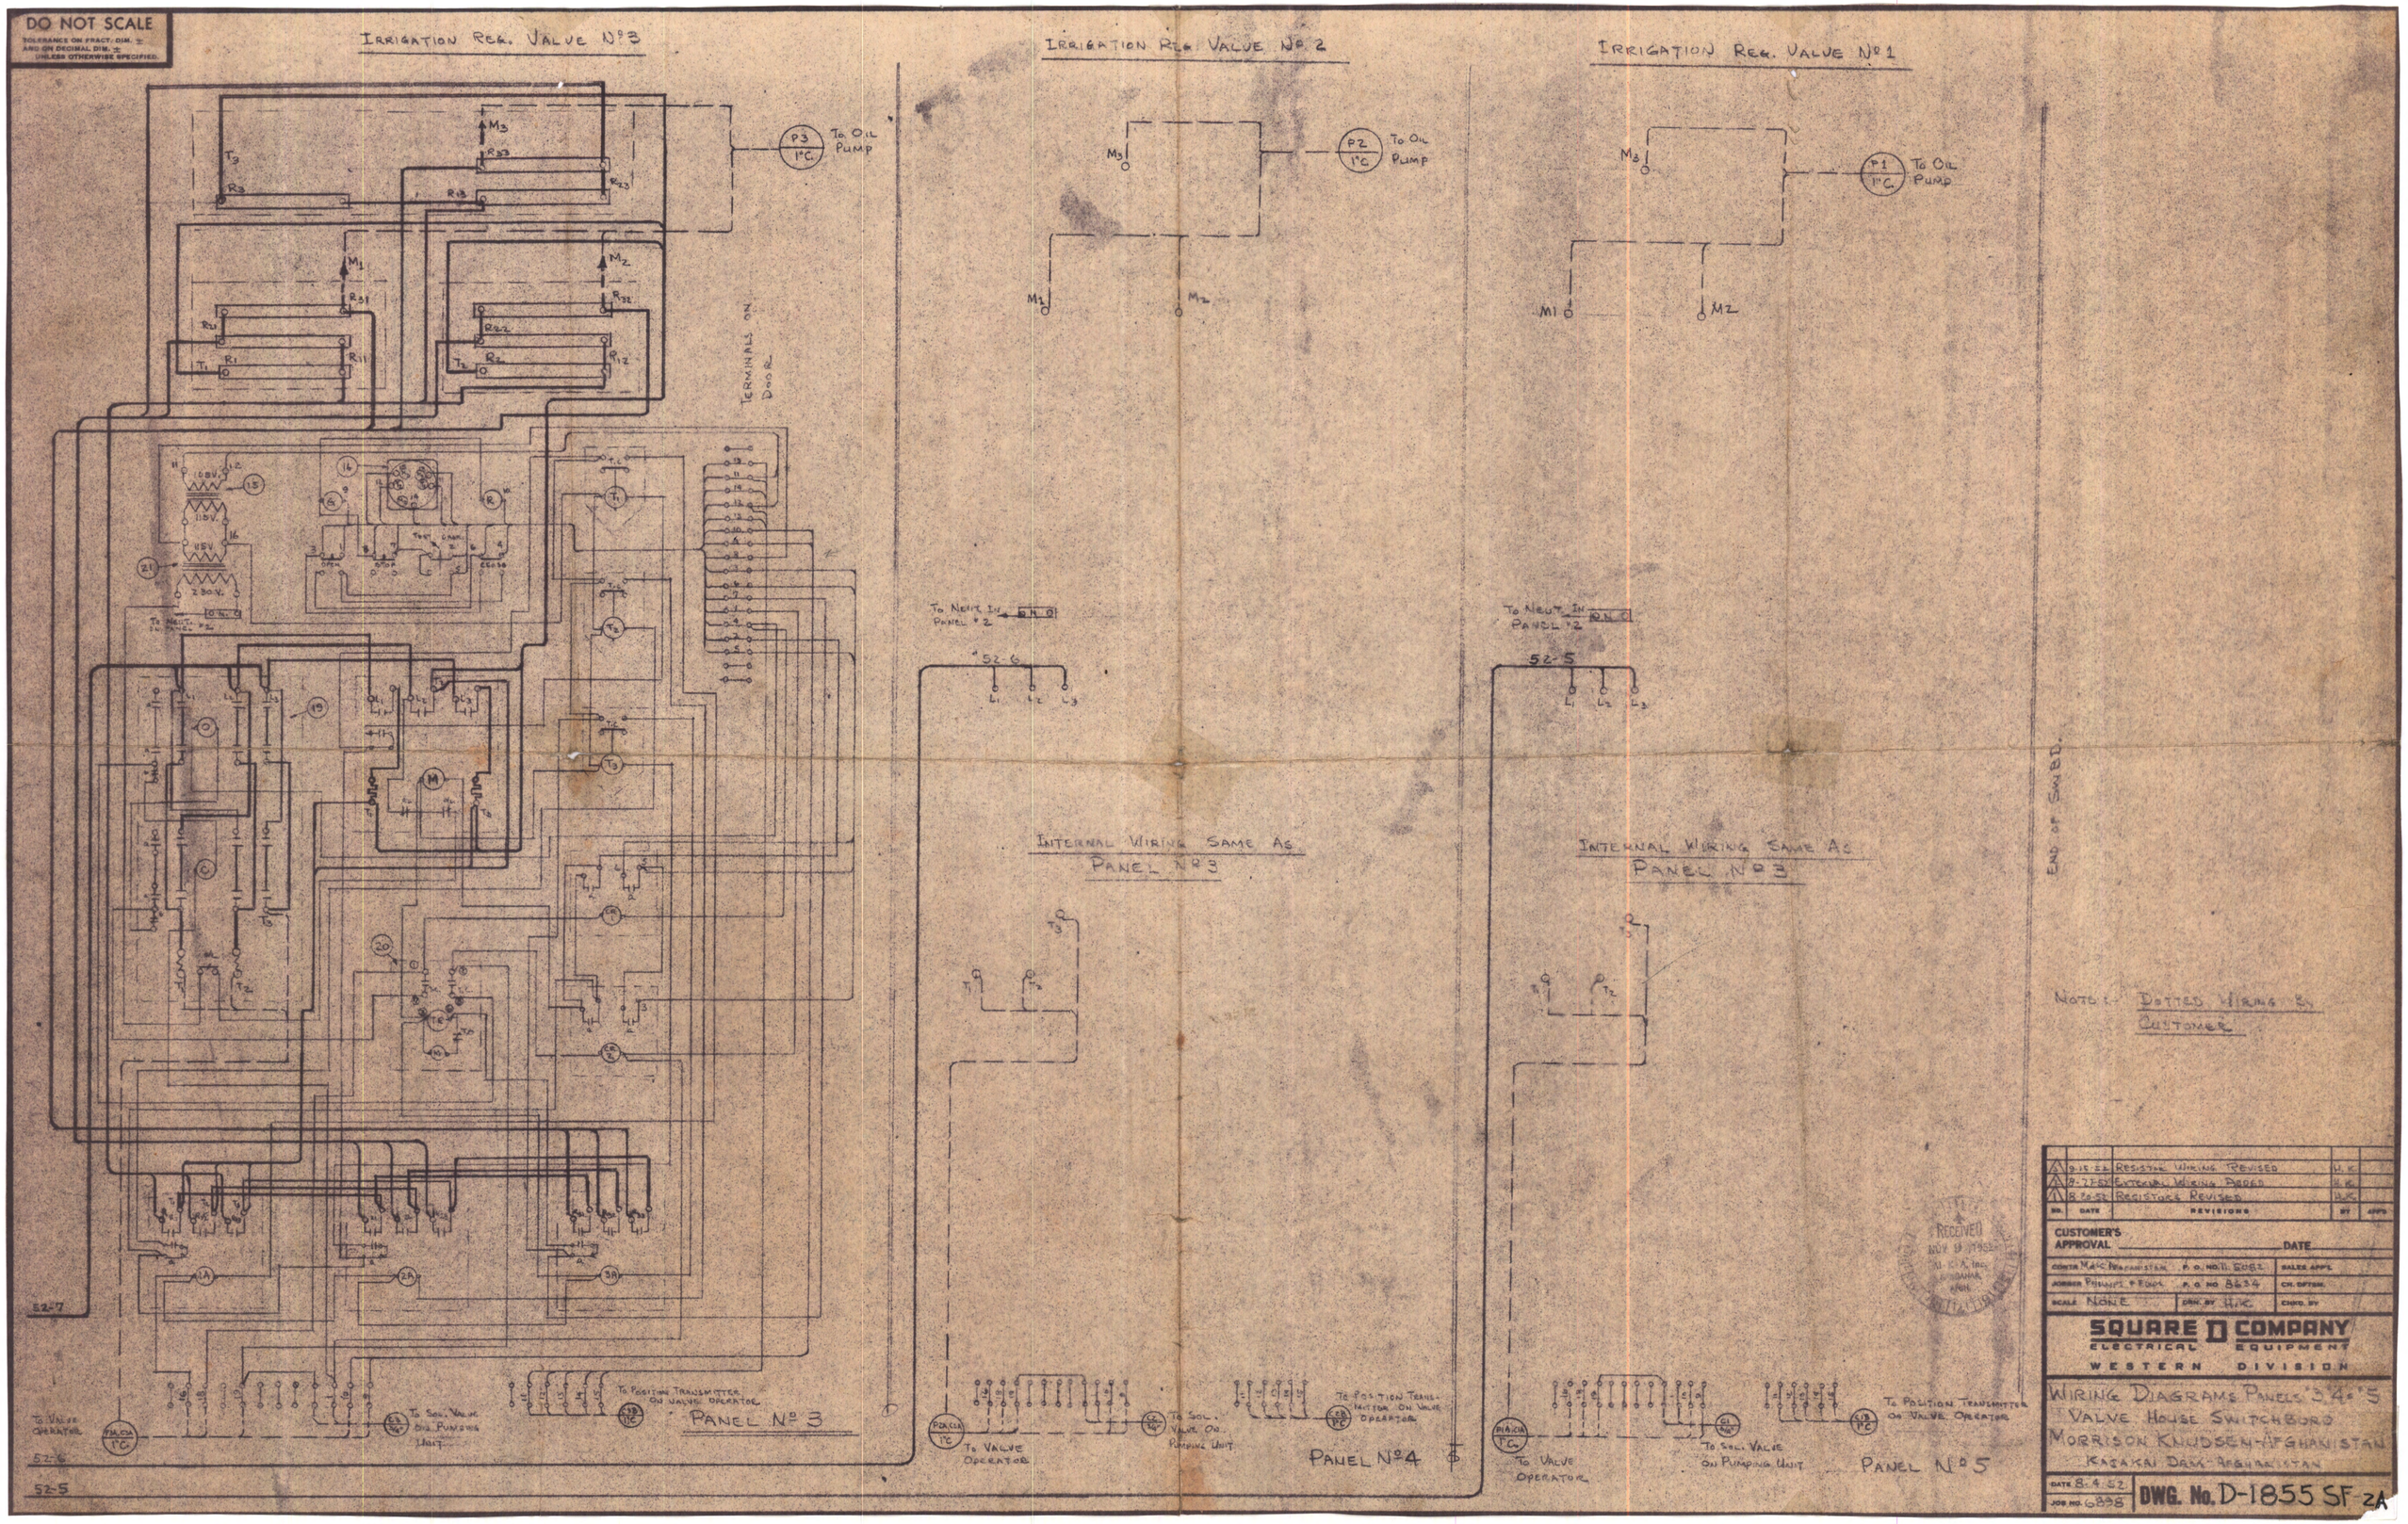
DO NOT SCALE
TOLERANCE ON FRACT. DIM. ± AND ON DECIMAL DIM. ± UNLESS OTHERWISE SPECIFIED.
IRRIGATION REG. VALVE No 3
IRRIGATION REG. VALVE No 2
IRRIGATION REG. VALVE No 1
P3 1°C. To Oil Pump
P2 1°C. To Oil Pump
P1 1°C. To Oil Pump
TERMINALS ON DOOR
To Neut. In Panel #2
52-6
52-5
INTERNAL WIRING SAME AS PANEL No 3
INTERNAL WIRING SAME AS PANEL No 3
END OF SWBD.
NOTE: DOTTED WIRING BY CUSTOMER
To Valve Operator
To Sol. Valve On Pumping Unit
To Position Transmitter On Valve Operator
PANEL No 3
PANEL No 4
PANEL No 5
52-7
52-6
52-5
RECEIVED NOV 19 1952
9-15-52 Resistor Wiring Revised H.K.
8-27-52 External Wiring Added H.K.
8-20-52 Resistors Revised H.K.
No. DATE REVISIONS BY APP'D
CUSTOMER'S APPROVAL DATE
CONTR. Mack Afghanistan P.O. No. 11 5052 SALES APP'L
JOBBER Phillips & Eddy P.O. No 8634 CH. DFTSM.
SCALE NONE DRN. BY H.K. CHKD. BY
SQUARE D COMPANY
ELECTRICAL EQUIPMENT
WESTERN DIVISION
WIRING DIAGRAMS PANELS 3, 4 & 5
VALVE HOUSE SWITCHBORD
MORRISON KNUDSEN-AFGHANISTAN
KAJAKAI DAM-AFGHANISTAN
DATE 8.4.52
JOB No. 6898
DWG. No. D-1855 SF 2A