

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT			1. CONTRACT ID CODE	PAGE OF PAGES 1 4
2. AMENDMENT/MODIFICATION NO. 0003	3. EFFECTIVE DATE 22-Jul-2012	4. REQUISITION/PURCHASE REQ. NO.		5. PROJECT NO.(If applicable)
6. ISSUED BY AFGHANISTAN DISTRICT SOUTH (AES) US ARMY CORPS OF ENGINEERS APO AE 09355	CODE W5J9LE	7. ADMINISTERED BY (If other than item 6) See Item 6		
8. NAME AND ADDRESS OF CONTRACTOR (No., Street, County, State and Zip Code)		X	9A. AMENDMENT OF SOLICITATION NO. W5J9LE-12-R-0062	
		X	9B. DATED (SEE ITEM 11) 03-Jul-2012	
			10A. MOD. OF CONTRACT/ORDER NO.	
			10B. DATED (SEE ITEM 13)	
CODE	FACILITY CODE			
11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS				
<input checked="" type="checkbox"/> The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of offer <input type="checkbox"/> is extended, <input checked="" type="checkbox"/> is not extended. Offer must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended by one of the following methods: (a) By completing Items 8 and 15, and returning <u>1</u> copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.				
12. ACCOUNTING AND APPROPRIATION DATA (If required)				
13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS. IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.				
A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.				
B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(B).				
C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:				
D. OTHER (Specify type of modification and authority)				
E. IMPORTANT: Contractor <input type="checkbox"/> is not, <input type="checkbox"/> is required to sign this document and return _____ copies to the issuing office.				
14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.) Southern Electrical Power System Kandahar Transmission Lines & Substation Compound This amendment is issued to: -Provide the remainder technical questions with answers. -Attached Appendix C Transmission Area Map (Proposed Main and Sub) Receipt of proposal due date remains the same 06 August 2012. POC: Clairice Dingle at claurice.m.dingle@usace.army.mil				
Except as provided herein, all terms and conditions of the document referenced in Item 9A or 10A, as heretofore changed, remains unchanged and in full force and effect.				
15A. NAME AND TITLE OF SIGNER (Type or print)		16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print)		
		TEL:	EMAIL:	
15B. CONTRACTOR/OFFEROR	15C. DATE SIGNED	16B. UNITED STATES OF AMERICA		16C. DATE SIGNED
_____ (Signature of person authorized to sign)		BY _____ (Signature of Contracting Officer)		22-Jul-2012

SECTION SF 30 BLOCK 14 CONTINUATION PAGE

SUMMARY OF CHANGES

SECTION 00010 - SOLICITATION CONTRACT FORM

The following have been modified:

OFFEROR QUESTIONS**Answers to offerors' questions are as follows:**

(Questions that may be of general interest to all offerors/Government and that are not readily answered by the preceding changes will appear below. These questions may have been paraphrased or altered to represent several questions regarding the same subject and or clarify and simplify the question(s). Questions and answers are issued to the offerors for information only.)

QUESTION 1. Due to the detailed field investigation requirements, multiple design submittals and government review periods as well as long lead procurement for electrical transformers we respectfully request the performance period be revised to 550 calendar days from NTP.

ANSWER 1. The Performance Period is revised to 550 Calendar days. Please pen and ink this change.

QUESTION 2. In regard to the unpredictable security environment and the ability to develop a firm-fixed price we request allowances for actual cost incurred be included in the bid documents to cover security costs for the project as was recently done for the procurement for the SEPS Transmission and Substation Lines, Helmand Province.

ANSWER 2. Question under review. Offerors are instructed to price as is.

QUESTION 4. Specification Section 01010, pg. 24, Paragraph 6, "Government Furnished Material... states: that the "Government will provide 4/0 ACSR conductor", whereas Specification Section 01060, pg. 16, paragraph 2.8, "Government Furnished Materials", states: "GFM consist of 3/0 ACSR conductor" Please clarify.

ANSWER 4. Government will provide 4/0 ACSR. Please pen and ink change Section 01060, pg. 16, paragraph 2.8, "Government Furnished Materials", states: "GFM consist of **4/0** ACSR conductor Will provide answer in subsequent amendment.

QUESTION 5. Please provide product data sheet for the GFM ACSR Conductor.

ANSWER 5. Data sheets for the GFM ACSR conductor will be available when the option is exercised.

QUESTION 6. Please provide product data sheet for the GFM Overhead Ground Wire (OWG)

ANSWER 6. Data sheet for the GFM Overhead Ground Wire (OWG) will be available when the option is exercised.

QUESTION 8. Section 01010-25 Paragraph 5, references bid items 0004AA through 0004AF. Option 2 Bid schedule reflects only 0004AA through 0004AD. **A) What are the correct bid items for Option 2?**

ANSWER 8. Per attached sheet – please pen and ink changes for this section.

QUESTION 17. Solicitation Offer Page 1 of 123, Item 8 Period of Performance. We have performed analysis of this project (based on previous NEPS and SEPS solicitations) and understand the details involved, including equipment long lead and transportation requirements. The 365-day period of performance is deemed unachievable. **Will USACE consider extending the Period of Performance to 550-days as originally indicated in the Pre-Solicitation?**

ANSWER 17. The Performance Period is revised to 550 Calendar days. Please pen and ink this change.

QUESTION 18. Appendix C, Proposed Maiwand Substation, All four longitude/latitude point coordinates are listed the same. **What are the correct longitude/latitude coordinates for the four point locations?**

ANSWER 18. Attached is the substation coordinate information.

Offerors are direct to delete

Section 01010, 5. OVERHEAD GROUND WIRE (OPTION 2)


“ . . . This option shall have a unit measure of cost per linear Kilometer between the poles and shall be paid for under optional bid item 0004AA through 0004AF “OPTION 2 – OGW Installation” of Options Bid Schedule C, Electrical Transmission and Overhead Ground Option Schedules (Section 00010).”

Replace instead with,

Section 01010, 5. OVERHEAD GROUND WIRE (OPTION 2)

“ . . . This option shall have a unit measure of cost per linear Kilometer between the poles and shall be paid for under optional bid item 0004AA through 0004AD “OPTION 2 – OGW Installation” of Options Bid Schedule C, Electrical Transmission and Overhead Ground Option Schedules (Section 00010).”

(End of Summary of Changes)

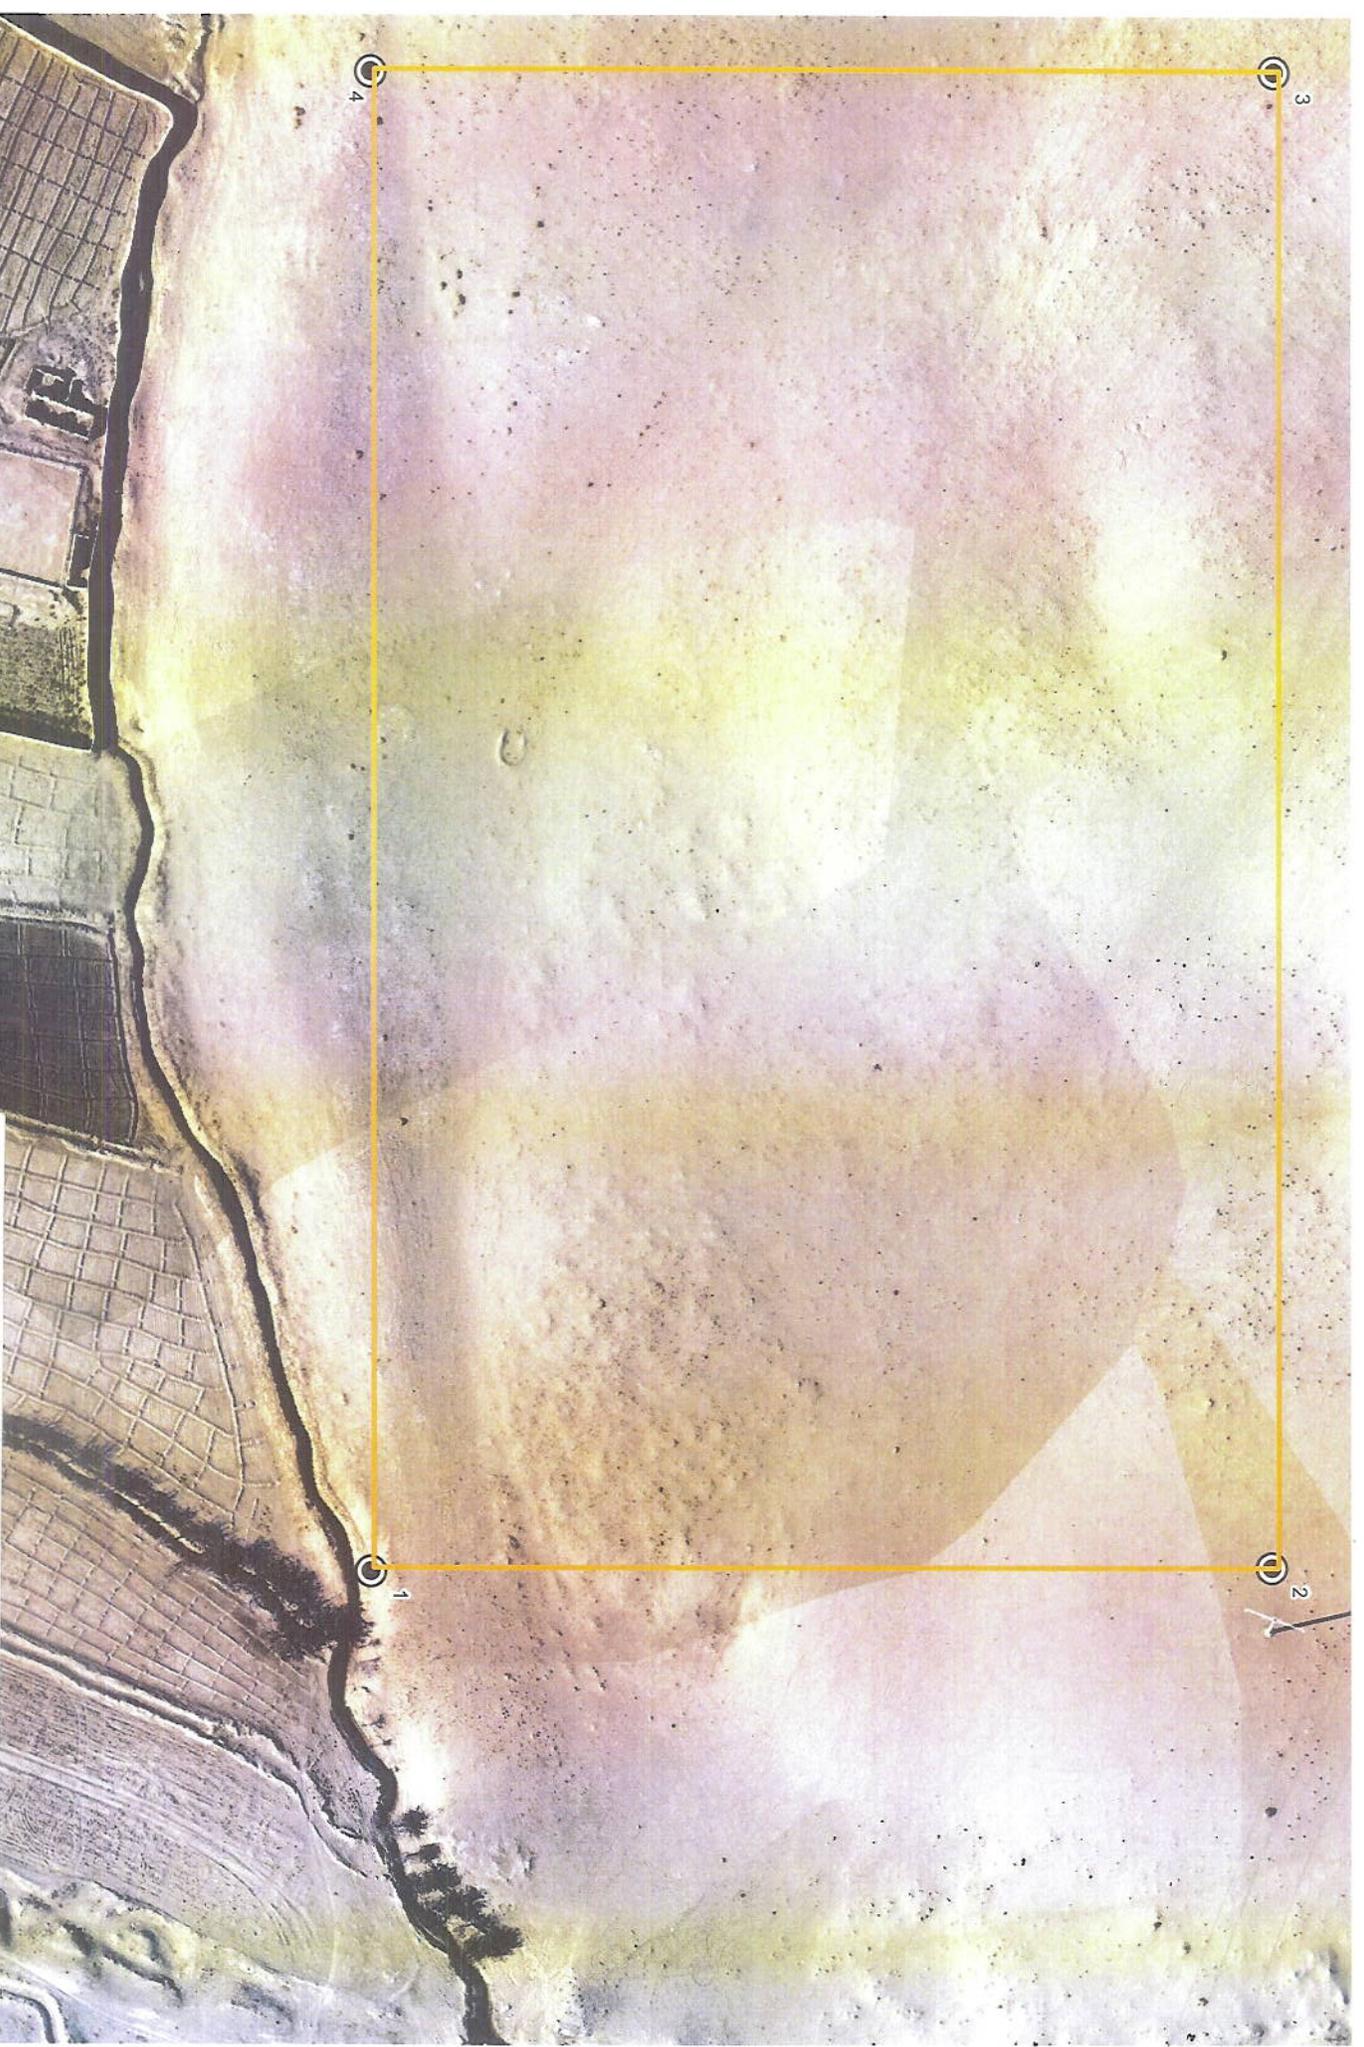

OBJECTID * DD_LAT DD_LONG UTM_X UTM_Y MGRS

1	31.63256	65.057984	695178	3501548	41R PR 9517801548
2	31.633906	65.058007	695177	3501697	41R PR 9517701697
3	31.633951	65.055376	694928	3501697	41R PR 9492801697
4	31.6326	65.05535	694928	3501548	41R PR 9492801548