

| AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT | | | 1. CONTRACT ID CODE | PAGE OF PAGES | |
|--|--|----------------------------------|--|---|--|
| 2. AMENDMENT/MODIFICATION NO. 0001 | | 3. EFFECTIVE DATE 09-Mar-2012 | 4. REQUISITION/PURCHASE REQ. NO. | | 5. PROJECT NO.(If applicable) 1 2 |
| 6. ISSUED BY AFGHANISTAN DISTRICT SOUTH (AES) US ARMY CORPS OF ENGINEERS APO AE 09355 AFGHANISTAN | | CODE W5J9LE | 7. ADMINISTERED BY (If other than item 6) See Item 6 | | CODE |
| 8. NAME AND ADDRESS OF CONTRACTOR (No., Street, County, State and Zip Code) | | | X | 9A. AMENDMENT OF SOLICITATION NO. W5J9LE-12-T-0014 | |
| | | | X | 9B. DATED (SEE ITEM 11) 01-Mar-2012 | |
| | | | | 10A. MOD. OF CONTRACT/ORDER NO. | |
| | | | | 10B. DATED (SEE ITEM 13) | |
| CODE | | FACILITY CODE | | | |
| 11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS | | | | | |
| <input checked="" type="checkbox"/> The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offer <input type="checkbox"/> is extended, <input checked="" type="checkbox"/> is not extended. Offer must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended by one of the following methods: (a) By completing Items 8 and 15, and returning <u>1</u> copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified. | | | | | |
| 12. ACCOUNTING AND APPROPRIATION DATA (If required) | | | | | |
| 13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS. IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14. | | | | | |
| A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A. | | | | | |
| B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(B). | | | | | |
| C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF: | | | | | |
| D. OTHER (Specify type of modification and authority) | | | | | |
| E. IMPORTANT: Contractor <input type="checkbox"/> is not, <input type="checkbox"/> is required to sign this document and return _____ copies to the issuing office. | | | | | |
| 14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.) PROJECT NO.: O&M 12-036 Procurement Technician: vivian.f.coleman@usace.army.mil SOLICITATION NO.: 205th AIR CORPS, FLOOD LIGHTS Solicitation is amended to add the attached sketches All terms and conditions remain the same | | | | | |
| Except as provided herein, all terms and conditions of the document referenced in Item 9A or 10A, as heretofore changed, remains unchanged and in full force and effect. | | | | | |
| 15A. NAME AND TITLE OF SIGNER (Type or print) | | | 16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print) VIVIAN F COLEMAN / ADDED BY SUMI TEL: 540 722 6393 EMAIL: vivian.f.coleman@usace.army.mil | | |
| 15B. CONTRACTOR/OFFEROR _____ (Signature of person authorized to sign) | | 15C. DATE SIGNED | 16B. UNITED STATES OF AMERICA BY _____ (Signature of Contracting Officer) | | 16C. DATE SIGNED 09-Mar-2012 |

SECTION SF 30 BLOCK 14 CONTINUATION PAGE

SUMMARY OF CHANGES

(End of Summary of Changes)

TOWER 176

The panel is fed by 6mm, 4 cable, armored cable.


Number of open circuits:

| | | | |
|--------|--------|--------|--------|
| 63 Amp | 1 each | 20 Amp | 4 each |
| 16 Amp | 4 each | 10 Amp | 3 each |
| 10 Amp | 3 each | 6 Amp | 3 each |


Tower 176 Continued

- There are currently 6 each 20 amp circuits currently being used.
- 1 Spot Light
- 1 Exterior Light
- 2 Interior tube lights (total of 4 tubes)
- 1 HVAC Unit
- 4 Receptacles

176 Fed by 6mm wire

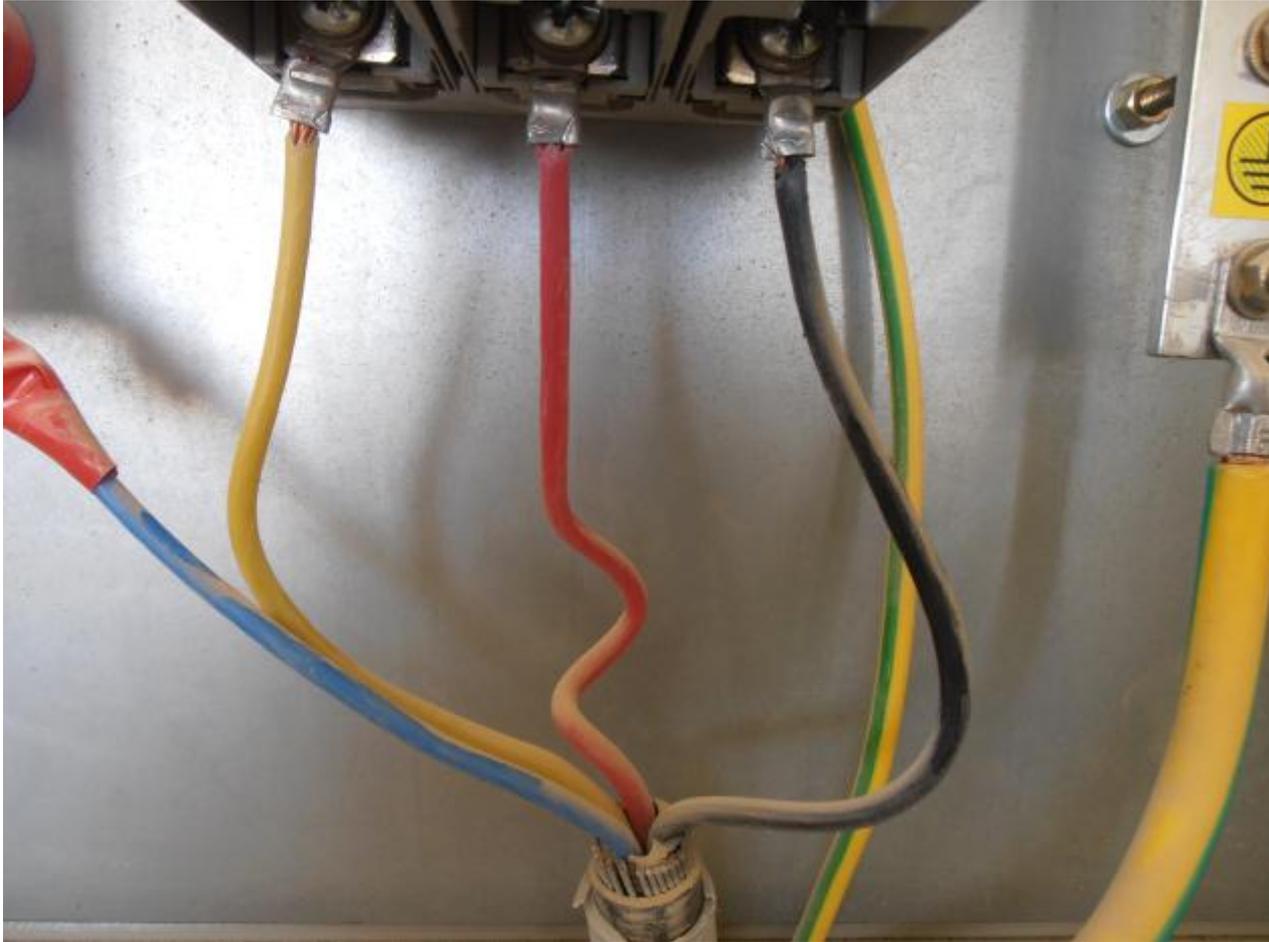

100 Amp Main Breaker

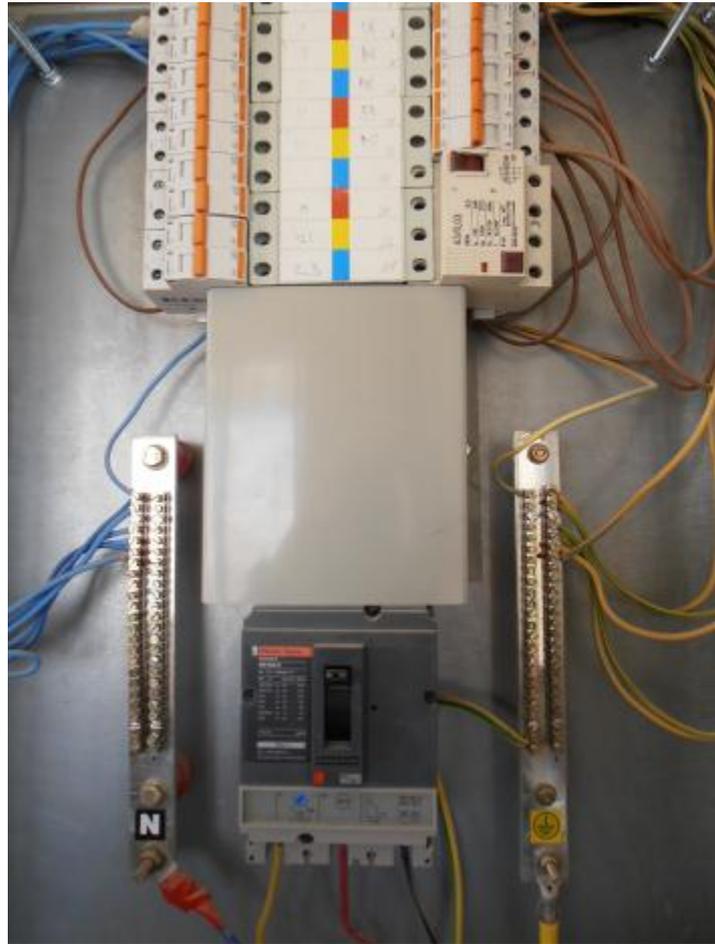

Tower 271

- The panel is fed by 16mm, 4 cable, armored cable
- Number of open circuits:

| | | | |
|--------|--------|--------|--------|
| 20 Amp | 2 each | 16 Amp | 6 each |
| 10 Amp | 3 each | 6 Amp | 3 each |

271 Continued

- The are currently 4 each 20 amp circuits and 2 32 amp circuits currently being used.
- 1 Spot Light
- 1 Exterior Light
- 2 Interior tube lights (total of 4 tubes)
- 1 HVAC Unit
- 4 Receptacles

100 Amp Main Breaker



Misc. Notes

- Not sure at this which MDP the towers are fed from, or if they are fed from a building.