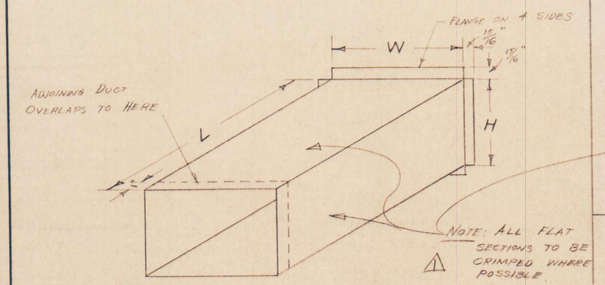

IDENTIFYING MARK	QUANTITY REQUIRED	DIMENSIONS IN INCHES		
		L	W	H
3	1	47*	36	20
5	128	35	36	20
6	1	46	36	20
8	1	34	36	20
10	1	35*	36	20
12	1	17*	36	20
13	1	18*	36	20
14	1	15*	36	20
17	1	35‡	36	20
18	1	40*†	36	20
20	1	15*	36	20
21	1	35*	36	20
22	1	40	36	20
26	1	33*	22	12
28	1	47	22	12
31	1	35	22	11
32	1	9	6	11
36	1	5	12	6
39	1	26¾"	16	11
40	1	27"	16	11
42	2	35	26	8
43	1	39½"	26	8

* MAKE DUCT THIS LENGTH IN SHOP — TRIM TO EXACT LENGTH REQ'D IN FIELD.

‡ INSTALL ANGLE IRON FLANGE FOR REMOVABLE DUCT CONNECTION IN PLACE OF BENT FLANGE SHOWN — SEE DETAIL X ON DWG. No. 15-F-59

† INSTALL ANGLE IRON FLANGE FOR REMOVABLE DUCT CONNECTION IN PLACE OF CLIP SHOWN — SEE DETAIL X ON DWG. No. 15-F-59

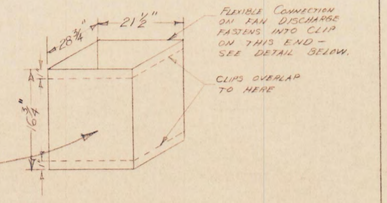

ONE REQ'D. 1

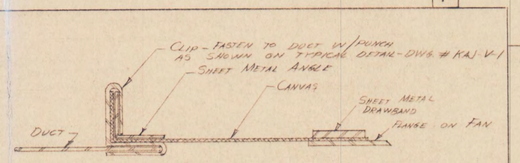

DETAIL OF TYPICAL FLEXIBLE CONNECTION

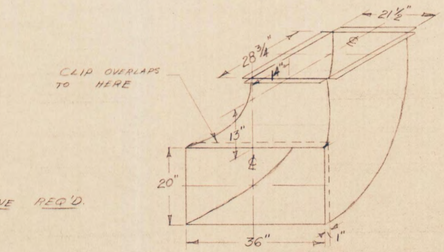

ONE REQ'D. 2

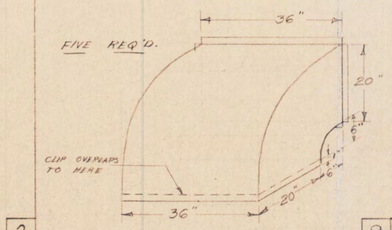

FIVE REQ'D. 9 4

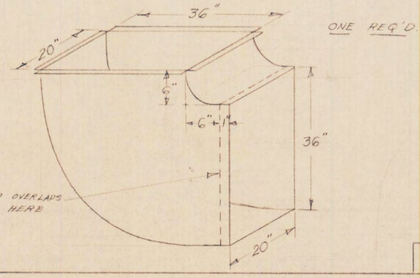

ONE REQ'D. 7

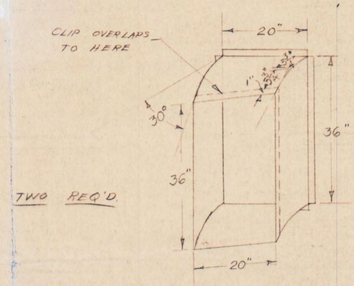

TWO REQ'D. 11

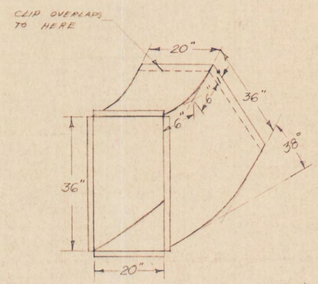

TWO REQ'D. 15 19

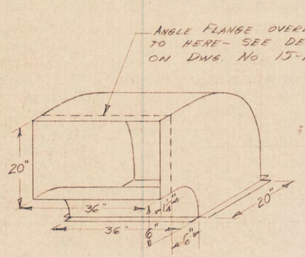

ONE REQ'D. 16-R

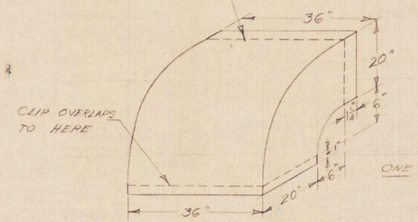

ONE REQ'D. 16-L

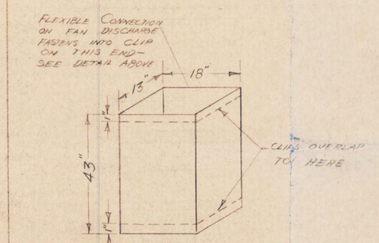

ONE REQ'D. 24

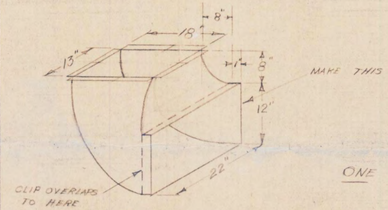

ONE REQ'D. 25

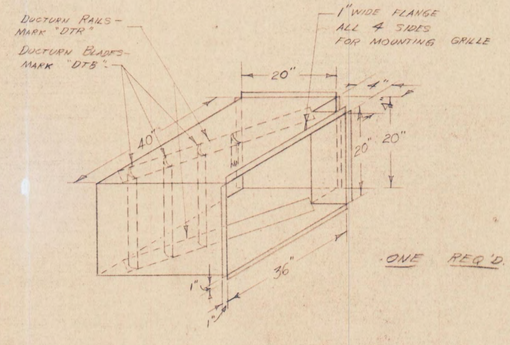

ONE REQ'D. 23-TOP

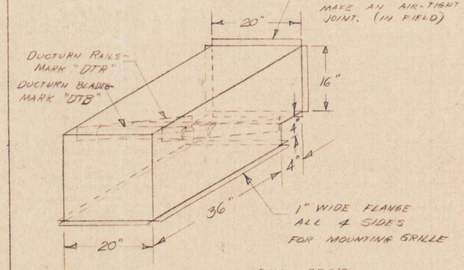

ONE REQ'D. 23-BOT.



ONE REQ'D. 35



TWO REQ'D. 38



ONE REQ'D. 41

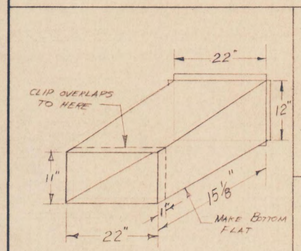

ONE REQ'D. 30

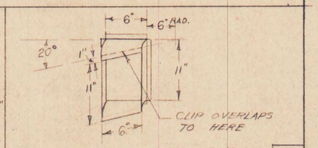

ONE REQ'D. 33

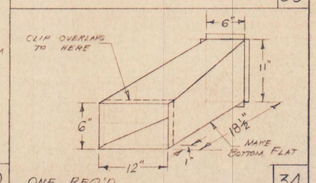

ONE REQ'D. 34

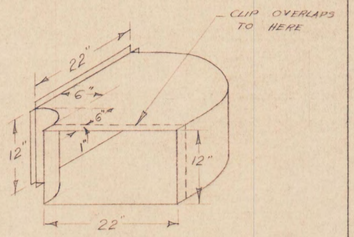

ONE REQ'D. 27

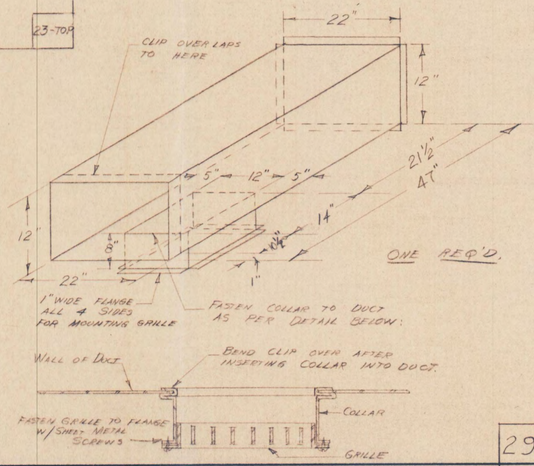

ONE REQ'D. 29



ONE REQ'D. 37



TWO REQ'D.

APPROVED EXCEPT AS NOTED
INTERNATIONAL ENGINEERING COMPANY, INC.
BY: [illegible] DATE: [illegible]

Rev.	Added Note.	7/31/52	44

KAJAKAI DAM
IRRIGATION TUNNEL VENTILATING SYSTEM

SCALE: NONE	APPROVED BY:	DRAWN BY: SWH
DATE: 7/16/52		REVISED:

DUCTWORK DETAILS

SCOTT CO. ~ MECH. CONTR. | DRAWING NUMBER: KAJ-V-2

24X36 PRINTED ON NO. 1000H CLEARPRINT