


AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT			1. CONTRACT ID CODE J	PAGE OF PAGES 1 2
2. AMENDMENT/MODIFICATION NO. 0002	3. EFFECTIVE DATE 03-Jul-2007	4. REQUISITION/PURCHASE REQ. NO.		5. PROJECT NO.(If applicable)
6. ISSUED BY US ARMY CORPS OF ENGINEERS - CETAC-CT-M 201 PRINCE FREDERICK DRIVE WINCHESTER VA 22602	CODE W912ER	7. ADMINISTERED BY (If other than item 6) See Item 6		
8. NAME AND ADDRESS OF CONTRACTOR (No., Street, County, State and Zip Code)		X	9A. AMENDMENT OF SOLICITATION NO. W912ER-07-R-0011	
		X	9B. DATED (SEE ITEM 11) 22-Jun-2007	
			10A. MOD. OF CONTRACT/ORDER NO.	
			10B. DATED (SEE ITEM 13)	
CODE	FACILITY CODE			
11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS				
<input checked="" type="checkbox"/> The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offer <input type="checkbox"/> is extended, <input checked="" type="checkbox"/> is not extended. Offer must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended by one of the following methods: (a) By completing Items 8 and 15, and returning _____ copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.				
12. ACCOUNTING AND APPROPRIATION DATA (If required)				
13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS. IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.				
A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.				
B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(B).				
C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:				
D. OTHER (Specify type of modification and authority)				
E. IMPORTANT: Contractor <input type="checkbox"/> is not, <input type="checkbox"/> is required to sign this document and return _____ copies to the issuing office.				
14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.)				
1. This amendment is issued to replace the following drawings in their entirety: Sheet S-1 (AF0715 B-SB01PN) and Sheet S-2 (AF0715 B-SB02EL)				
2. Specifications are not affected by this amendment				
Except as provided herein, all terms and conditions of the document referenced in Item 9A or 10A, as heretofore changed, remains unchanged and in full force and effect.				
15A. NAME AND TITLE OF SIGNER (Type or print)		16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print)		
		TEL:	EMAIL:	
15B. CONTRACTOR/OFFEROR	15C. DATE SIGNED	16B. UNITED STATES OF AMERICA		16C. DATE SIGNED
_____ (Signature of person authorized to sign)		BY _____ (Signature of Contracting Officer)		03-Jul-2007

SECTION SF 30 BLOCK 14 CONTINUATION PAGE

A B C D E F G H

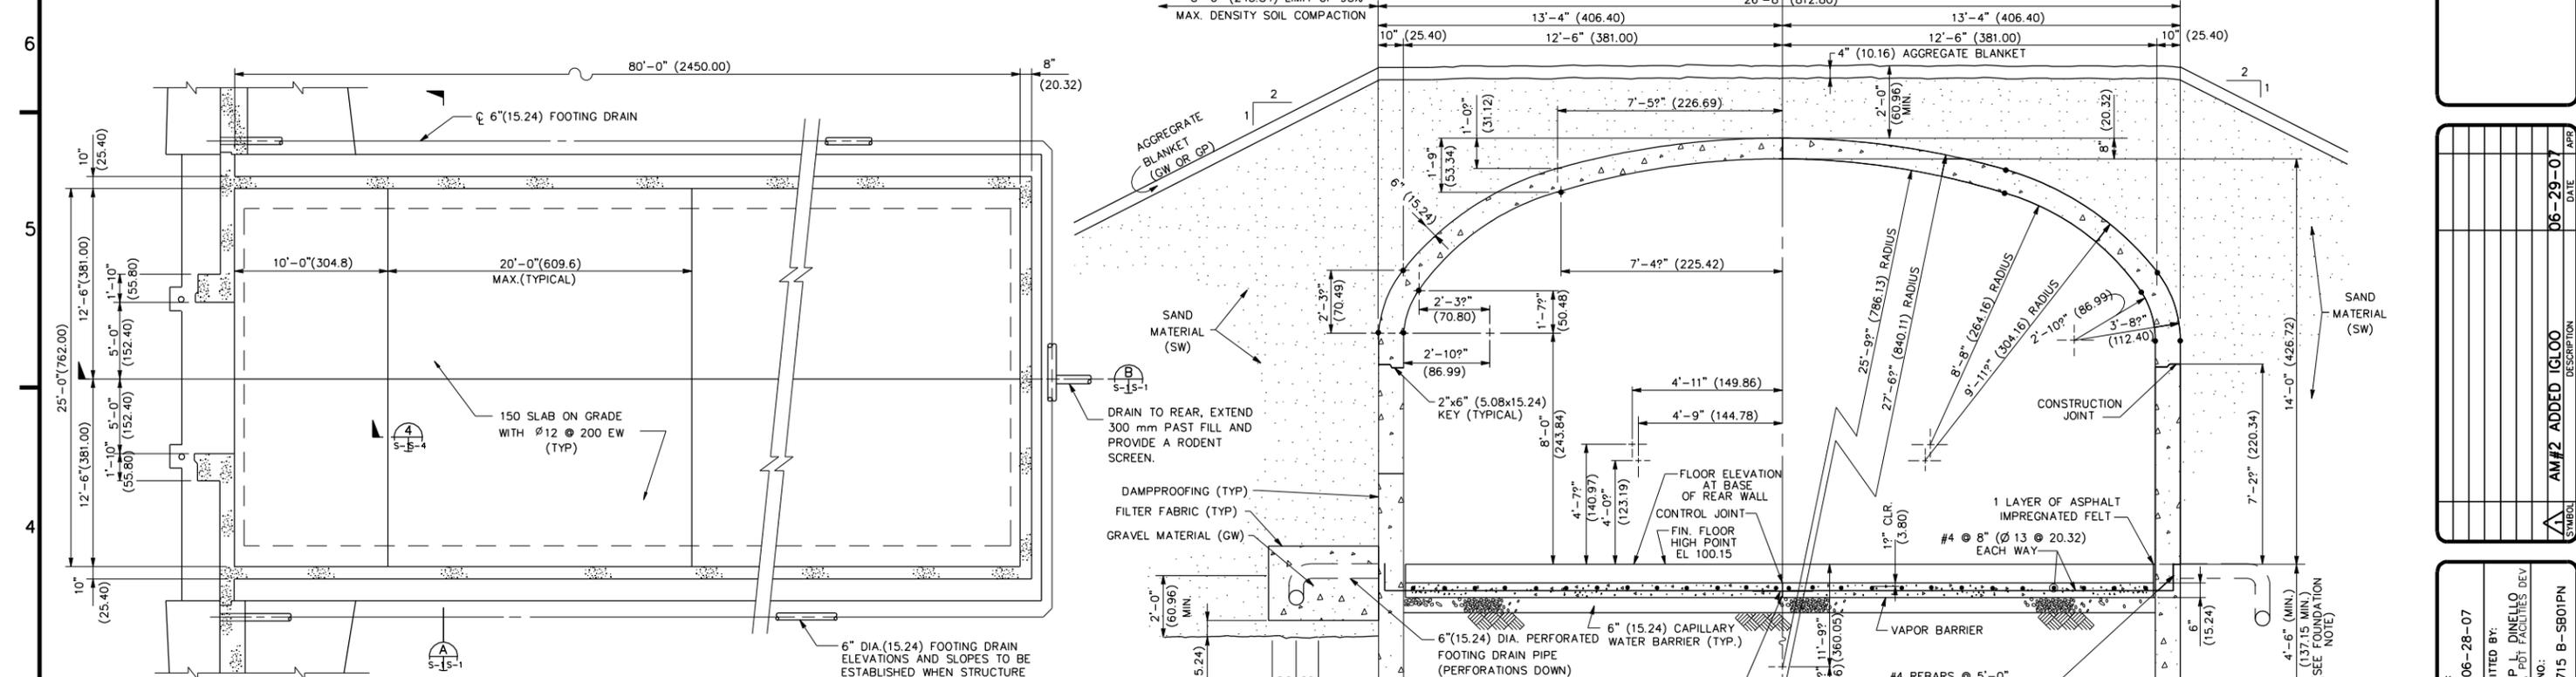

PLAN
NOT TO SCALE

SECTION A
NOT TO SCALE

SECTION B
NOT TO SCALE

SECTION C
OPTIONAL CONSTRUCTION METHOD AT TOP OF SIDE WALLS

NOTES:

1. FOR ADDITIONAL NOTES REFER TO STANDARD DWG SS-1.
2. FOR BUILDING ORIENTATION SEE CIVIL DWGS.
3. CONCRETE SHALL HAVE 28 DAY ULTIMATE STRENGTH (f'c) OF 4,000 P.S.I.
4. REINFORCING STEEL SHALL BE ASTM A615 GRADE 60
5. DIMENSIONS SHOWN IN PARENTHESES ARE CENTIMETERS UNLESS OTHERWISE NOTED.(FOR INFO ONLY) ALL REBAR METRIC SIZES ARE IN MILLIMETERS.
6. DRAINS TO DRAIN TO THE REAR OF THE MAGAZINE.
7. ALL METAL PARTS, TO INCLUDE REINFORCEMENT, LOUVERS, VENTILATOR, DOOR, DOOR FRAME, ETC., SHALL BE MADE ELECTRICALLY CONTINUOUS BY CLIPPING, BRAZING, OR WELDING. ELECTRICAL CONTINUITY SHALL BE PROVIDED ACROSS FLOOR CONSTRUCTION JOINTS AND ACROSS FLOOR ISOLATION JOINTS TO ARCH REINFORCEMENT AT 5 LINEAR FEET INTERVALS. ACCEPTABLE ELECTRICAL CONTINUITY METHODS ARE REINFORCEMENT BARS, COPPER STRAPS, ETC.
8. A CLASS "C" FINISH IS REQUIRED FOR EXPOSED FORMED SURFACES. A CLASS "D" FINISH IS REQUIRED FOR FORMED SURFACES WHICH WILL BE BELOW GRADE OR NOT EXPOSED TO VIEW AFTER ASSEMBLY. PROVIDE A STEEL TROWLED FINISH TO FLOOR SLAB. SEE SPECIFICATION SECTION 03300.

ARMY STANDARDS MAGAZINE
STD 33-15-74

NOT TO SCALE

NOTE APPLIES TO ALL FACILITIES WITHIN SCOPE OF PROJECT

FOUNDATION NOTE:

FOUNDATION HAVE BEEN DESIGNED USING AN ALLOWABLE BEARING PRESSURE OF 1.2 KG/SQ. CM. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING THAT THE ALLOWABLE BEARING PRESSURE OF 1.2 KG/SQ CM IS ACCEPTABLE. IF THE CONTRACTOR DETERMINES THE ALLOWABLE BEARING PRESSURE IS LESS THAN THE 1.2 KG/SQ CM, THE CONTRACTOR AT HIS EXPENSE SHALL DO WHATEVER IS NECESSARY TO IMPROVE THE SUBSURFACE CONDITION TO OBTAIN AN ALLOWABLE BEARING PRESSURE OF 1.2 KG/SQ CM. ALL FOUNDATIONS SHALL BE PLACED A MINIMUM OF 1.5 METERS BELOW THE LOWEST EXISTING GROUND SURFACE WITHIN THE FOOTPRINT OF THE BUILDING

6/28/2007
h:\projects\Afghanistan\af0715B\af0715B-SB01PN.dwg



SYMBOL	AM#2	ADDED	IGLOO	DESCRIPTION	DATE	APP.
					06-29-07	

DESIGNED BY:	DATE:	06-28-07
ARMY		
DWN BY:	SUBMITTED BY:	PHILIP L. DINELLO DEV
ARMY		CHIEF, PBT FACILITIES
CHK BY:	FILE NO.:	AF0715 B-SB01PN
KGO		


US Army Corps of Engineers
Transatlantic Programs Center

COUNTER EXPLOSIVES SCHOOL
ANA COMANDO COMPLEX
RISH KHOVOOR, AFGHANISTAN
MUNITIONS STORAGE IGLOO TYPE A
FOUNDATION PLAN AND SECTION


SHEET REFERENCE NUMBER:
B
S-1

UNLESS OTHERWISE NOTED, LINEAR DIMENSIONS SHOWN ARE IN MILLIMETERS.


6/28/2007 10:07:15 a.m. \\projects\Afghanistan\af0715\af0715b-sb02EL.dwg

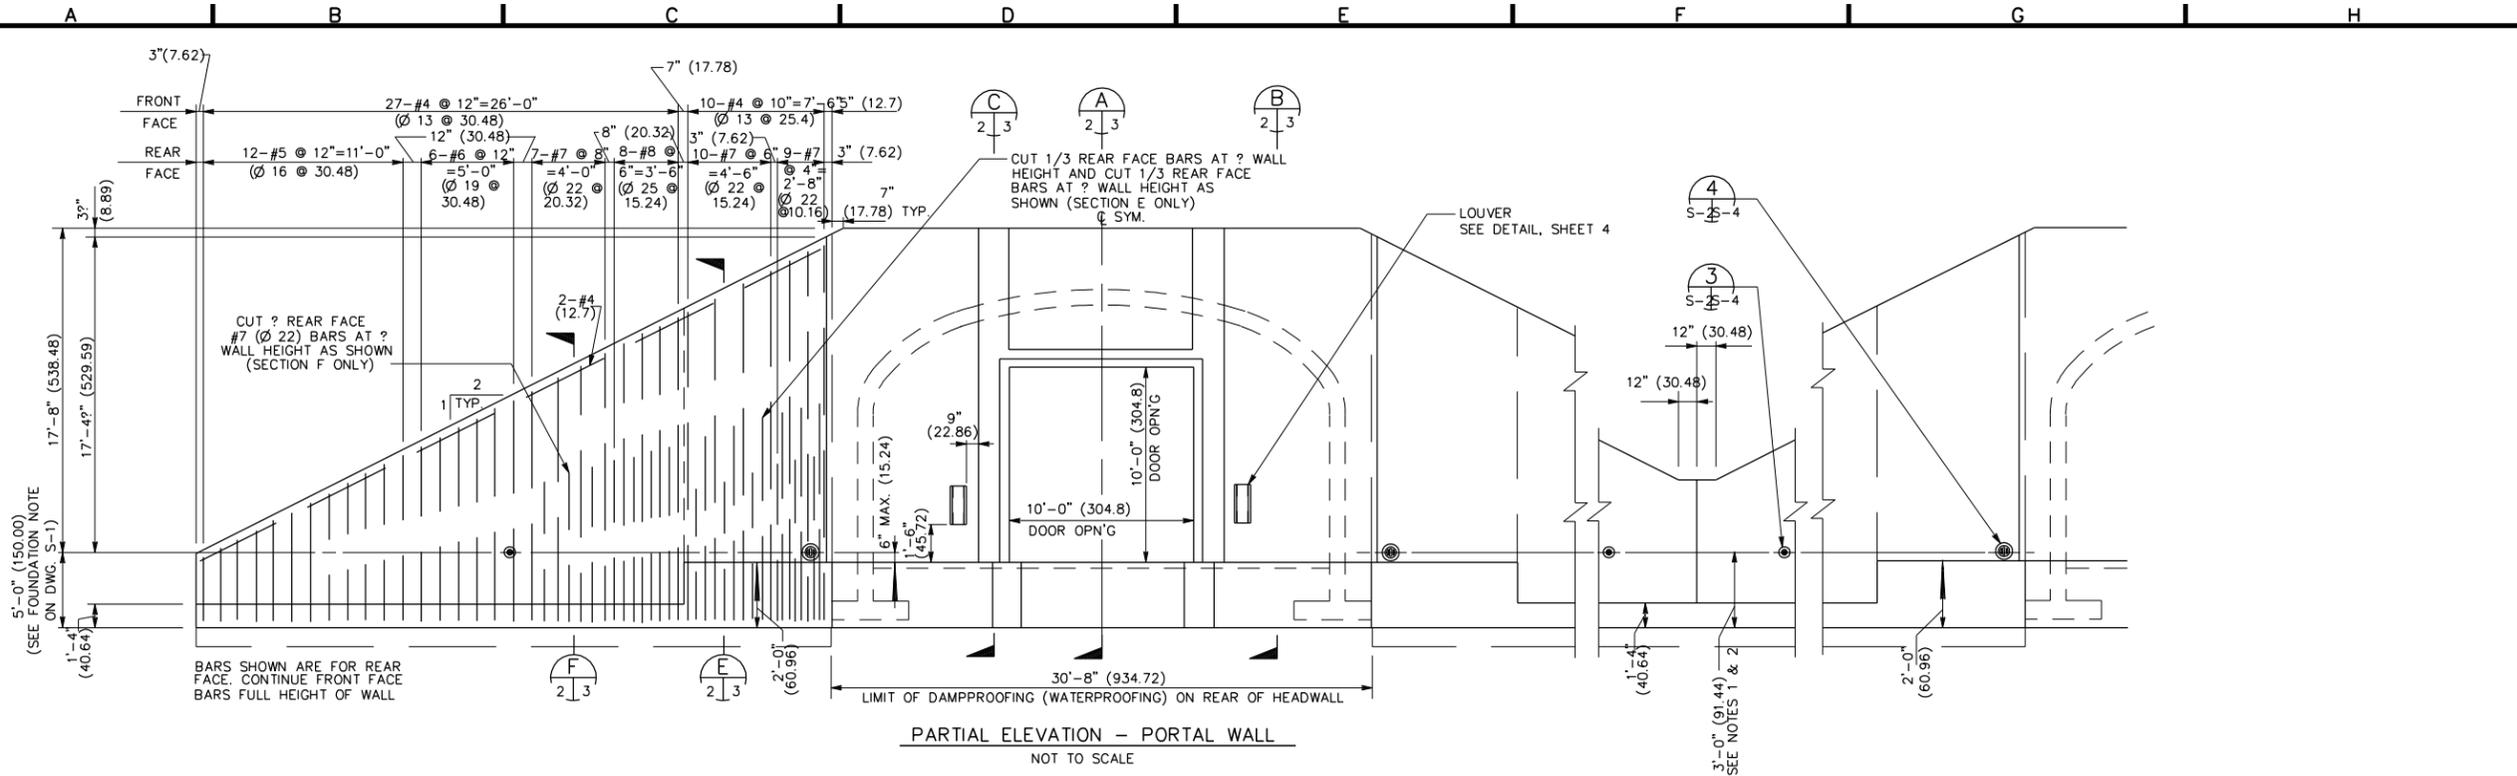


PARTIAL ELEVATION - PORTAL WALL
NOT TO SCALE

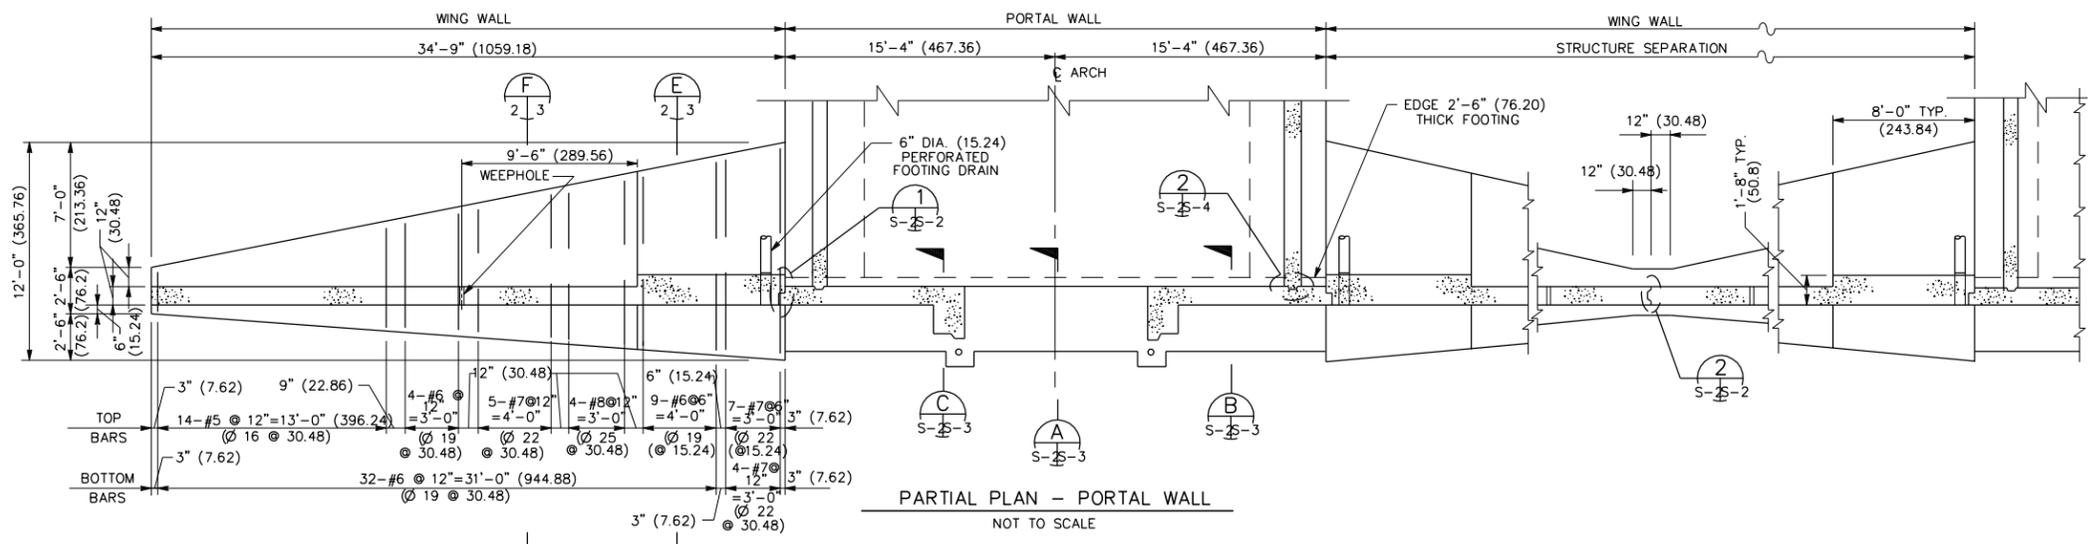

PARTIAL PLAN - PORTAL WALL
NOT TO SCALE

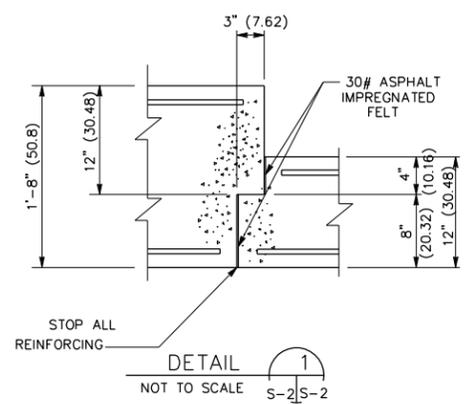


DETAIL 1
NOT TO SCALE S-2/S-2

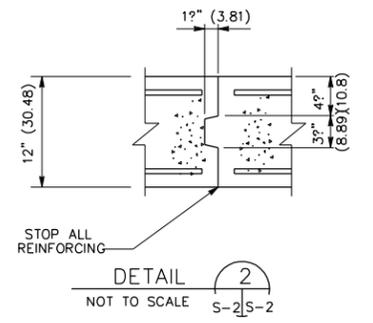

DETAIL 2
NOT TO SCALE S-2/S-2

NOT TO SCALE

UNLESS OTHERWISE NOTED, LINEAR DIMENSIONS SHOWN ARE IN MILLIMETERS.



SYMBOL	AM# 2	ADDED	IGLOO	DESCRIPTION
DATE	06-29-07			

DESIGNED BY:	DATE:	06-28-07
ARMY		
DWN BY:	SUBMITTED BY:	R. KORTYOHANN
ARMY	CHIEF, PDI SITE DEV	
CHK BY:	FILE NO.:	AF0715 B-SB02EL
KGO		

US Army Corps of Engineers
Transatlantic Programs Center

COUNTER EXPLOSIVES SCHOOL
ANA COMMANDO COMPLEX
RISH KHOVDOR, AFGHANISTAN
MUNITIONS STORAGE IGLOO TYPE A
PORTAL WALL
PLAN, ELEVATION AND DETAILS

SHEET REFERENCE NUMBER:
B
S-2